

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



October 29, 2024

Mr. Brett Prochazka
Plainedge Union Free School District
Administration Building
241 Wyngate Drive
North Massapequa, New York 11758

Re: **Lead Testing in School Drinking Water
Remedial Action Plan – October 2024 Update
2023-2025 Compliance 10 NYCRR Subpart 67-4**

JCB#: **23-53781**

Dear Mr. Prochazka:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 5 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead in Water Remediation Plan
Attachment 2: Outlet Inventory and Lead Testing Results
Attachment 3: Laboratory Analytical Reports
Attachment 4: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.
Sincerely,

A handwritten signature in black ink, appearing to read 'Anthony J. Lombardo', is positioned below the 'Sincerely,' text.

Anthony J. Lombardo
Project Manager
J.C. BRODERICK & ASSOCIATES, INC.

Attachment 1:

Lead in Water Remediation Plan


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

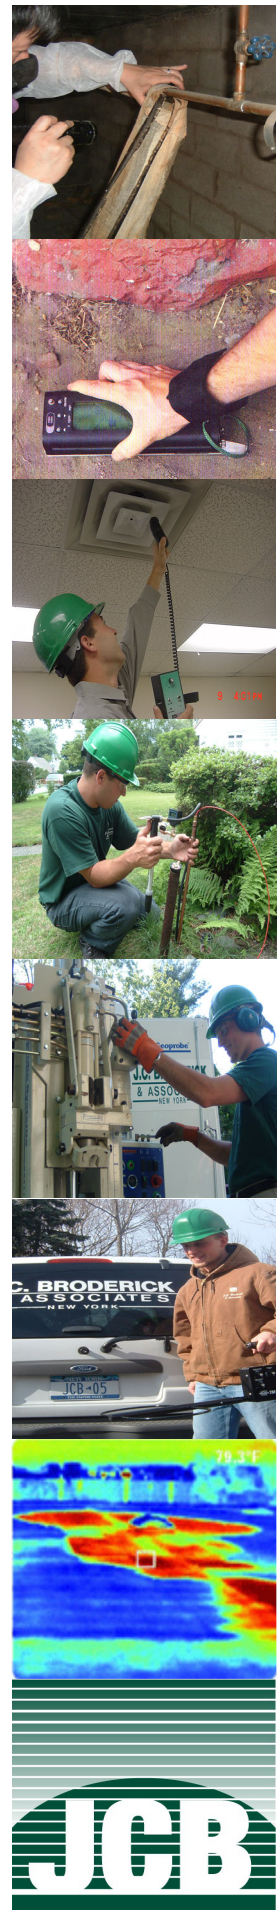

Lead in Water Remediation Plan

Section 67-4.4 Response of the New York State Department of Health (NYS DOH) Title 10 of the Official Compilation of the Codes, Rules and Regulations of the State of New York requires:

If the lead concentration of water at an outlet exceeds the action level, the school shall:

(a) prohibit use of the outlet until:

(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and

(2) test results indicate that the lead levels are at or below the action level;

As historical sampling results have indicated, the concentrations of lead are more likely attributable to the individual fixtures and/or their immediately adjoining plumbing, and not with the building-wide plumbing. Based upon this information, the following remedial steps are recommended:

Step 1A: Potable Outlets (Outlets intended to be used for drinking/cooking)

Immediately remove the fixture from service. If necessary, provide an adequate supply of potable water for drinking/cooking to this location at no cost to the occupants. If an outlet is seldomly used or is unnecessary, the district may consider permanent removal of the outlet and capping of its supply line.

Step 1B: Non-Potable Outlets (Outlets not intended for drinking/cooking)


See Step 1A OR Placard the outlet for non-drinking use. Signs must be clearly visible and in close proximity to the affected outlet. Example signage is provided at: https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns_lead.pdf.



Do not use for drinking



Hand washing only

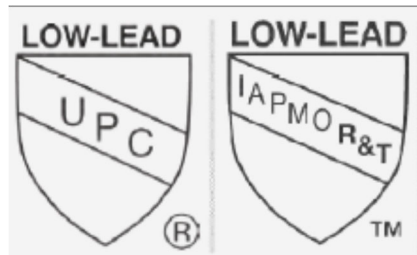

Step 2: Service & Repair or Outlet Replacement

The school district's plumber should evaluate the outlet to determine if any components require service or repair. Depending on the extent of service/repair necessary, age of the fixture, and or overall costs, the district may consider replacing the outlet entirely. Any newly installed components shall be certified lead free. (i.e. NSF/ANSI 61, NSF/ANSI-273). If servicing involves installing/replacing a point-of-use filtration system, this filter shall be certified for its lead reduction capability (i.e. NSF/ANSI 53). Follow all manufacturer's instructions for all component installations. OUTLET RESTRICTIONS MUST REMAIN IN PLACE UNTIL SATISFACTORY TEST RESULTS ARE RECEIVED. See Step 3.

Step 3: Retesting & Return to Service

Schedule a retest of the outlet. Outlet restrictions must remain in place until lead testing results at or below the action level are received. Once satisfactory results are received, the outlet may be returned to normal service. Note: It is recommended that "Do Not Drink" signage remain in place for all non-potable and non-applicable outlet types.

Attachment 2:

Outlet Inventory and Lead Testing Results

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53781

Plainedge Union Free School District

Charles E. Schwarting Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0001	Room 1	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0004	Room 2	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0006	Room 3	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0008	Room 4	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0010	Room 5	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0012	Room 7	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0013	Media Center Room 8 (Library)	N/A	Kitchen Faucet (Cold)	Potable	6/14/2024	1.1			Result Below Action Level Continue O&M
PUFSD-0014	Room 9 Bathroom	1000B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0015	Room 9 Bathroom	1000B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0016	Room 9 Custodial Closet	1000C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0017	Bathroom	1002	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0019	Room 11	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0020	Room 11 Bathroom	1003A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0021	Room 11 Bathroom	1003A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0023	Room 13	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0025	Room 15	1005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Charles E. Schwarting Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0027	Room 12	1006B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0028	Room 14	1009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0029	Main Office Principal's Office Bathroom	1013C2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0030	Room 16	1010	Hand Wash Only	Non-Applicable	6/14/2024	31.7			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
PUFSD-0031	Main Office Bathroom	1013B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0032	Kitchen Custodial Closet	1016B3	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0033	Kitchen Bathroom	1016B2A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0034	Kitchen	1016B	Kitchen Faucet (Cold)	Potable	6/14/2024	18.2	8/15/2024	1.6	Outlet Remediated and Returned to Service Continue O&M
PUFSD-0035	Kitchen	1016B	Kitchen Faucet (Cold)	Potable	6/14/2024	3.0			Result Below Action Level Continue O&M
PUFSD-0038	Kitchen	1016B	Spray Nozzle	RFI	6/14/2024	20.6			Outlet Permanently Removed
PUFSD-0039	Cafeteria	1016	Bottle Fill Station	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0040	Cafeteria	1016	Water Cooler	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0041	Nurse's Office	1018A	Nurse's Office Sink	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0042	Women's Bathroom	1020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0043	Faculty Lounge	1021	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0044	Men's Bathroom	1023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0045	Men's Bathroom Closet	1023A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0046	Gym Vestibule	1022D	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
PUFSD-0047	Girl's Bathroom	1029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0048	Girl's Bathroom	1029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Charles E. Schwarting Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0049	Girl's Bathroom	1029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0052	Boy's Bathroom	1031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0053	Boy's Bathroom	1031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0054	Boy's Bathroom	1031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0055	Boy's Bathroom Slop Sink	1031A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0056	Room 29 Bathroom	1032B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0057	Room 28	1033	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0059	Custodian Closet	1035	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0060	Room 30	1037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0062	Room 33	1038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0064	Room 35	1040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0066	Room 32	1039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0068	Room 34	1041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0070	Room 37	1044	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0072	Corridor Room 37 to Elevator	1052	Water Cooler	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0073	Room 36	1045	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0075	Room 38	1040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0077	Room 39	1047	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0079	Room 40	1048	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0081	Room 41	1049	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Charles E. Schwarting Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0083	Room 43	1050	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0085	Room 42	1051	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0087	Corridor Room 37 to Elevator	1052	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
PUFSD-0088	Room 52	2000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0090	Corridor Room 44 to Room 52	2012	Water Fountain-No Chiller	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0091	Room 53	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0093	Room 51	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0095	Room 50	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0097	Room 49	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0099	Room 48	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0101	Room 46	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0103	Boy's Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0104	Boy's Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0105	Corridor Room 44 to Room 52	2012	Water Cooler	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0106	Custodial Closet	2008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0107	Girl's Bathroom	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0108	Girl's Bathroom	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0109	Girl's Bathroom	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0110	Girl's Bathroom	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0111	Room 45	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Charles E. Schwarting Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0112	Work Room	0004	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0113	Greenhouse o/s Room 14	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0114	Greenhouse o/s Room 14	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0115	Greenhouse o/s Room 14	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0116	Exterior Hose Bib o/s Main Office	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0117	Exterior Hose Bib o/s Room 15	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0118	Exterior Hose Bib o/s Room 9	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0119	Exterior Hose Bib o/s Room 7	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0120	Exterior Hose Bib o/s Room 3	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0121	Exterior Hose Bib o/s Room 3	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0122	Exterior Hose Bib o/s Room 25	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0123	Exterior Hose Bib o/s Room 6	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0124	Exterior Hose Bib o/s Room 2	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0125	Exterior Hose Bib o/s Room 42	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0126	Exterior Hose Bib o/s Room 28	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0127	Exterior Hose Bib o/s Room 34	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0128	Exterior Hose Bib o/s Room 33	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0778	Main Office Principal's Office	1013C	Bottled Water Dispenser	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0779	Kitchen	1016B	Kitchen Faucet (Cold)	Potable	6/14/2024	2.1			Result Below Action Level Continue O&M
PUFSD-0780	Kitchen	1016B	Pasta Pot/Steam Kettle	Potable	6/14/2024	1.4			Result Below Action Level Continue O&M

Charles E. Schwarting Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0823	Corridor Girls Bathroom to Room 34	1042	Bottle Fill Station	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0824	Corridor Girls Bathroom to Room 34	1042	Water Cooler	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0825	Girls Bathroom	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0826	Girls Bathroom	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0827	Girls Bathroom Interior Bathroom	2009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0828	Custodial Closet	2008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0829	Boys Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0830	Boys Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0831	Boys Bathroom	2007	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0832	Boys Bathroom Interior Bathroom	2007A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0833	Girls Bathroom	2009	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0834	Kitchen	1016B	Kitchen Faucet (Cold)	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0835	Kitchen	1016B	Kitchen Faucet (Cold)	Potable	4/5/2024	1.2	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0836	Exterior Hose Bib o/s Greenhouse	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0837	Exterior Hose Bib o/s Café	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0884	Gym Vestibule	1022D	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0914	Main Office Principal's Office	1013C	Bottled Water Dispenser (Hot)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0915	Media Center Room 8 (Library)	N/A	Spray Nozzle	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M

Eastplain Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0129	Room 1	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0131	Room 2	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0133	Room 3	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0135	Library	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0136	Room 5	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0138	Room 7	1000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0140	Room 9	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0142	Room 10	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0146	Room 12	1008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0148	Room 14	1010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0150	Room 13	1009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0152	Room 15	1011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0154	Room 16	1012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0156	Room 17	1013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0158	Room 12 A Handicap Bathroom	1016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0159	Health Office Room 19	1018	Nurse's Office Sink	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0160	Kitchen Bathroom	1021A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0161	Kitchen	1021A	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0164	Kitchen	1021A	Kitchen Faucet (Cold)	Potable	6/14/2024	4.7			Result Below Action Level Continue O&M
PUFSD-0165	Cafeteria	1022	Bottle Fill Station	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M

Eastplain Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0166	Cafeteria	1022	Water Cooler	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0167	Faculty Room 23 Kichinette	1025A	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0168	Women's Bathroom	1026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0169	Corridor Men's Bathroom to Gym	1028	Water Cooler	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0170	Corridor Men's Bathroom to Gym	1028	Water Fountain-No Chiller	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0171	Men's Bathroom	1027	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0172	Men's Bathroom Slop Sink Closet	1027A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0173	Room 36	1042	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0175	Room 35	1041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0177	Room 34	1040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0179	Room 33	1039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0181	Room 32	1038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0183	Room 31	1037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0185	Room 30	1036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0187	Room 29	1035	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0189	Room 28	1034	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0191	Room 26	1030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0192	Room 26 Bathroom	1030A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0193	Greenhouse o/s Room 26	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0194	Greenhouse o/s Room 26	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Eastplain Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0195	Bathroom	1031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0196	2nd Basement Corridor Stairs to 1st Floor	0008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0197	Boys Bathroom Custodial Closet	1007B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0198	Exterior Hose Bib o/s Room 9	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0199	Exterior Hose Bib o/s Room 13	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0200	Exterior Hose Bib o/s Room 7	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0201	Exterior Hose Bib o/s Room 27	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0202	Exterior Hose Bib o/s Room 28	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0203	Exterior Hose Bib o/s Room 30	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0204	Exterior Hose Bib o/s Room 36	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0205	Exterior Hose Bib o/s Room 35	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0206	Exterior Hose Bib o/s Room 31	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0207	Exterior Hose Bib o/s Kitchen	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0208	Exterior Hose Bib o/s Room 6	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0209	Exterior Hose Bib o/s Room 2	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0210	Exterior Hose Bib o/s Exit #4	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0838	Corridor Room 7 to Room 17	1014	Bottle Fill Station	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0839	Corridor Room 7 to Room 17	1014	Water Cooler	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0840	Exterior Hose Bib o/s Room 3	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0885	Kitchen	1021A	Pasta Pot/Steam Kettle	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M

Eastplain Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0886	Kitchen	1021A	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M

John H. West Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0211	Main Office Bathroom	1049B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0212	Principal's Office Bathroom	1037A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0213	Room S14 Bathroom	1035	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0215	Boy's Bathroom	1036B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0216	Boy's Bathroom Custodial Closet	1036A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0217	Room 2	1040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0218	Room 6	1045	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0219	Greenhouse o/s Room 6	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0220	Greenhouse o/s Room 6	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0221	Room 10	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0223	Room 11	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0225	Media Center Room 12 (Library)	N/A	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0226	Room 13	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0228	Room 15	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0230	Room 16	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0232	Room 17	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0234	Room 19	1025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0235	Room 20	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0236	Room 22	1022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0237	Room 23	1021	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

John H. West Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0239	Room 24	1020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0240	Room 25	1019	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0242	Room 26	1018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0243	Room 27	1017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0244	Boy's Bathroom	1016A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0245	Boy's Bathroom	1016A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0246	Boy's Bathroom Cusstodial Closet	1016B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0247	Corridor Room 19 to Girls Bathroom	1026	Water Cooler	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0248	Girl's Bathroom	1014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0249	Girl's Bathroom	1014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0250	Room 28	1015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0252	Storage Closet in Custodian Office	1010A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0253	Custodian Office Room 32	1010	Bottled Water Dispenser (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0255	Room 36	1005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0256	Room 37	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0258	Room 39	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0260	Room 38	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0261	Room 40	1001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0263	Room 41	1000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0265	Corridor Room 49 to Room 42	2014	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service

John H. West Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0266	Room 49	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0268	Room 50	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0270	Room 48	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0272	Room 47	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0274	Room 46	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0276	Room 45	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0278	Boy's Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0279	Boy's Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0280	Room S11 Custodial Closet	2005	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0284	Corridor Room 49 to Room 42	2014	Water Cooler	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0285	Women's Bathroom	2002	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0286	Men's Bathroom	2001	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0287	Art Room 30	1013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0288	Art Room 30	1013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0289	Nurse's Office	1012	Nurse's Office Sink	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0290	Room 31 Bathroom	1012B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0291	Faculty Lounge	1027A	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0292	Faculty Lounge	1027A	Bottled Water Dispenser (Cold)	Potable	6/14/2024	OOS	8/15/2024	OOS	Testing Required Before Return to Service
PUFSD-0293	Faculty Lounge Bathroom	1027C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0296	Kitchen	1030	Kitchen Faucet (Cold)	Potable	6/14/2024	14.3	10/18/2024	< 1.0	Outlet Remediated and Returned to Service Continue O&M

John H. West Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0297	Kitchen	1030	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0298	Kitchen	1030	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0299	Girl's Bathroom	1033	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0300	Girl's Bathroom	1033	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0301	Water Heater Room	0008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0302	Boiler Room	0003	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0303	Exterior Hose Bib o/s Room 36	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0304	Exterior Hose Bib o/s Exit #6	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0305	Exterior Hose Bib o/s Room 37	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0306	Exterior Hose Bib o/s Room 20	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0307	Exterior Hose Bib o/s Room 17	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0308	Exterior Hose Bib o/s Room 16	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0309	Exterior Hose Bib o/s Room 13	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0310	Exterior Hose Bib o/s Room 13	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0311	Exterior Hose Bib o/s Room 9	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0312	Exterior Hose Bib o/s Room 7	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0313	Exterior Hose Bib o/s Main Office	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0314	Exterior Hose Bib o/s Gym	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0315	Exterior Hose Bib o/s Kitchen	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0841	Girls Bathroom	2004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

John H. West Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0842	Girls Bathroom	2004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0843	Girls Bathroom	2004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0844	Cafeteria	1029	Bottle Fill Station	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0845	Cafeteria	1029	Water Cooler	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0846	Kitchen	1030	Kitchen Faucet (Cold)	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0847	Kitchen	1030	Pasta Pot/Steam Kettle	Potable	4/5/2024	1.6	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0848	Corridor Room 8 to Room 14	1047	Bottle Fill Station	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0849	Corridor Room 8 to Room 14	1047	Water Cooler	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0850	Exterior Hose Bib o/s Café	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0887	Corridor Room 35 to Room 41	1008	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
PUFSD-0888	Bobcat Snack Shack Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0889	Bobcat Snack Shack Kitchen	N/A	Spray Nozzle	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0890	Bobcat Shack Unisex Restroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0893	Bobcat Shack Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0916	Faculty Lounge	1027A	Bottled Water Dispenser (Hot)	Potable	6/14/2024	OOS	8/15/2024	OOS	Testing Required Before Return to Service
PUFSD-0917	Custodian Office Room 32	1010	Bottled Water Dispenser (Hot)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0918	Media Center Room 12 (Library)	N/A	Spray Nozzle	Non-Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0316	Boy's Restroom o/s Room C307	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0317	Boy's Restroom o/s Room C307	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0318	Boy's Restroom o/s Room C307	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0320	Hallwayo/s Room C307	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0321	Girl's Restroom o/s Room C307	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0322	Girl's Restroom o/s Room C307	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0323	Girl's Restroom o/s Room C307	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0324	Faculty Restroom o/s Room C307	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0325	Custodial Closet c323	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0326	Custodial Closet o/s Room C339	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0327	Girl's Restroom o/s Room C339	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0328	Girl's Restroom o/s Room C339	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0329	Girl's Restroom o/s Room C339	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0330	Hallway o/s Room C339	N/A	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0331	Hallway o/s Room C339	N/A	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0332	Boy's Restroom o/s Room C339	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0333	Boy's Restroom o/s Room C339	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0334	Boy's Restroom o/s Room C339	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0335	Faculty Restroom o/s Room C339	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0336	Room C226	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0337	Room C226	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0338	Room C226	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0339	Room C226	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0340	Room C226	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0341	Room C226	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0342	Room C226	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0343	Room C226	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0344	Room C226 Storage	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0345	Room C228	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0346	Room C228	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0347	Room C228	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0348	Room C228	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0349	Room C228	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0350	Room C228	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0351	Room C228	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0352	Room C228	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0353	Room C228/C229 Storage	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0354	Room C228/C229 Storage	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0355	Room C229	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0356	Room C229	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0357	Room C229	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0358	Room C229	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0359	Room C229	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0360	Room C229	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0361	Room C229	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0362	Room C229	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0363	Faculty Restroom o/s Room C223	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0364	Boy's Restroom o/s Room C223	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0365	Boy's Restroom o/s Room C223	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0366	Boy's Restroom o/s Room C223	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0368	Hallway o/s Room C223	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0369	Girl's Restroom o/s Room C223	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0370	Girl's Restroom o/s Room C223	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0371	Girl's Restroom o/s Room C223	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0372	Custodial Closet C218	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0373	Room C214	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0374	Room C214	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0375	Room C214	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0376	Room C214	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0377	Room C214	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0378	Room C214	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0379	Room C214	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0380	Room C214	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0381	Room C213/C214 Storage	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0382	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0383	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0384	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0385	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0386	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0387	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0388	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0389	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0390	Room C213	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0391	Room C212	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0392	Room C212	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0393	Room C212	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0394	Room C212	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0395	Room C212	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0396	Room C212	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0397	Room C212	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0398	Room C212	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0399	Room C212B	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0400	Girl's Restroom o/s C205	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0401	Girl's Restroom o/s C205	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0402	Girl's Restroom o/s C205	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0403	Hallway o/s C205	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0404	Hallway o/s C205	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0405	Boy's Restroom o/s Room C205	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0406	Boy's Restroom o/s Room C205	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0407	Boy's Restroom o/s Room C205	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0408	Faculty Restroom o/s Room C205	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0409	Room C201 Technology	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0410	Room C201 Technology	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0411	Room C204	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0412	Room C204	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0413	Room C204	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0414	Room C204	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0415	Room C204	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0416	Room C204	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0417	Room C204	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0418	Room C204	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0419	Room C204/C203 Storage	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0420	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0421	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0422	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0423	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0424	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0425	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0426	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0427	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0428	Room C203	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0429	Room C202	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0430	Room C202	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0431	Room C202	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0432	Room C202	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0433	Room C202	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0434	Room C202	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0435	Room C202	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0436	Room C202	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0437	Custodial Office	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0438	Robotoics Lab A107	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0439	Robotoics Lab A107	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0440	Cafeteria	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0441	Cafeteria	N/A	Bottle Fill Station	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0442	Cafeteria	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0443	Kitchen Serving Line	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	2.4			Result Below Action Level Continue O&M
PUFSD-0444	Kitchen Serving Line	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	2.4			Result Below Action Level Continue O&M
PUFSD-0445	Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0446	Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0447	Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0448	Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0449	Kitchen	N/A	Kitchen Faucet (Cold)	RFI	6/13/2024	7.2	8/30/2024	127	Outlet Permanently Removed
PUFSD-0450	Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	4.9			Result Below Action Level Continue O&M
PUFSD-0451	Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	2.4			Result Below Action Level Continue O&M
PUFSD-0452	Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0453	Kitchen	N/A	Kitchen Non Potable	Non-Applicable	6/13/2024	68.5			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
PUFSD-0454	Kitchen	N/A	Pasta Pot/Steam Kettle	Potable	6/13/2024	1.3			Result Below Action Level Continue O&M
PUFSD-0455	Kitchen Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0456	Kitchen Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0457	Student Health Services A118	N/A	Nurse's Office Sink	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0458	Student Health Services A118 Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0459	Student Health Services A118	N/A	Nurse's Office Sink	Potable	6/13/2024	1.6			Result Below Action Level Continue O&M
PUFSD-0460	Media Center/Library Office	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0461	Room A121 Home Economics	N/A	Home Economics Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0462	Room A121 Home Economics	N/A	Home Economics Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0463	Faculty Women's Bathroom A123	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0464	Hallway o/s Faculty Women's Bathroom A123	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0465	Hallway o/s Faculty Women's Bathroom A123	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0466	Faculty Men's Bathroom A124	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0467	Faculty Men's Bathroom A124 Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0468	Room C110	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	2.5			Result Below Action Level Continue O&M
PUFSD-0469	Main Office	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0470	Guidance Office	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0472	Faculty Restroom o/s Auditorium	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0473	Boy's Bathroom o/s Auditorium	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0474	Boy's Bathroom o/s Auditorium	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0475	Boy's Bathroom o/s Auditorium	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0476	Auditorium Lobby Hallway	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0477	Auditorium Lobby Hallway	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0478	Girl's Restroom o/s Auditorium	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0479	Girl's Restroom o/s Auditorium	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0480	Girl's Restroom o/s Auditorium	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0481	Faculty Restroom o/s Auditorium	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0482	Cusdtodial Closet o/d Auditorium	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0483	C128 Storage	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0484	C139 Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0485	Girl's Locker Room Coach's Office Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0487	Girl's Locker Room Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0488	Girl's Locker Room Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0489	Girl's Locker Room Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0490	Girl's Locker Room Bathroom Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0491	Boy's Locker Room Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0492	Boy's Locker Room Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0493	Boy's Locker Room Bathroom Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0494	Boy's Locker Room Coach's Office Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0495	Boy's Locker Room Coach's Office	N/A	Ice Machine	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0496	Girl's Restroom o/s Gym	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0497	Girl's Restroom o/s Gym	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0498	Girl's Restroom o/s Gym	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0499	Hallway o/s Gym	N/A	Bottle Fill Station	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0500	Hallway o/s Gym	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0501	Hallway o/s Gym	N/A	Water Cooler	Potable	6/13/2024	OOS	8/15/2024	OOS	Testing Required Before Return to Service
PUFSD-0502	Boy's Restroom o/s Gym	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0503	Boy's Restroom o/s Gym	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0504	Boy's Restroom o/s Gym	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0505	Faculty Restroom o/s Gym	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0506	Room C146 Art Room	N/A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0507	Room C146 Art Room	N/A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0508	Room C147 Art Room	N/A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0509	Room C147 Art Room	N/A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0510	Room C147 Art Room	N/A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0511	Boy's Restroom o/s Cafeteria	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0512	Boy's Restroom o/s Cafeteria	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0513	Boy's Restroom o/s Cafeteria	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0514	Boy's Restroom Custodial Closet o/s Cafeteria	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0515	Hallway o/s Cafeteria	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0516	Hallway o/s Cafeteria	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0517	Girl's Restroom o/s Cafeteria	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0518	Girl's Restroom o/s Cafeteria	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0519	Girl's Restroom o/s Cafeteria	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0520	Room A112	N/A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0521	Room A111 Family and Consumer Science	N/A	Home Economics Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0522	Room A111 Family and Consumer Science	N/A	Home Economics Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0523	Room A111 Family and Consumer Science	N/A	Home Economics Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0524	Room A111 Family and Consumer Science	N/A	Home Economics Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0525	Basement Custodial Office/Lounge	N/A	Kitchen Faucet (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0526	Basement Custodial Office/Lounge Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0527	Basement Custodial Office/Lounge Storage	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0528	Room C302	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0529	Room C302	N/A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0530	Exterior Hose Bib o/s Exit #3	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0531	Exterior Hose Bib o/s Room A111	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0532	Exterior Hose Bib o/s Room A112	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0533	Exterior Hose Bib o/s Room C148	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0534	Exterior Hose Bib o/s Gym	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0535	Exterior Hose Bib o/s Girls Locker Room	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0536	Exterior Hose Bib o/s Stage	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0537	Exterior Hose Bib o/s Room C134	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0538	Exterior Hose Bib o/s Stage	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0539	Exterior Hose Bib o/s Kitchen	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0540	Exterior Hose Bib o/s Room C147	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0541	Exterior Hose Bib o/s Room A119	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0784	Hallway o/s Room C307	N/A	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0785	Principle's Office Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0786	Hallway o/s Room C307	N/A	Bottle Fill Station	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0863	2nd Floor Hallway o/s Room C223	N/A	Bottle Fill Station	Potable	4/5/2024	< 1.0	6/13/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0864	2nd Floor Hallway o/s Room C223	N/A	Water Cooler	Potable	4/5/2024	< 1.0	6/13/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0865	Exterior Greenhouse in Courtyard	N/A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0866	Exterior Hose Bib o/s Room C129	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0891	Kitchen	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0894	Kitchen	N/A	Pasta Pot/Steam Kettle	Potable	6/13/2024	19.7	8/30/2024	3.0	Outlet Remediated and Returned to Service Continue O&M
PUFSD-0895	Kitchen	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0896	Guidance Office	N/A	Bottled Water Dispenser	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0897	Girl's Locker Room	N/A	Water Cooler	Potable	6/13/2024	OOS			Testing Required Before Return to Service
PUFSD-0903	Room A111 Family and Consumer Science	N/A	Spray Nozzle	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0904	Room A111 Family and Consumer Science	N/A	Spray Nozzle	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0905	Room A111 Family and Consumer Science	N/A	Spray Nozzle	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0906	Room A111 Family and Consumer Science	N/A	Spray Nozzle	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0907	Student Health Services A118	N/A	Spray Nozzle	Non-Applicable	6/13/2024	11.1	9/13/2024	6.1	Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
PUFSD-0908	Student Health Services A118	N/A	Spray Nozzle	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M

Plainedge Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0909	Media Center/Library Office	N/A	Spray Nozzle	Potable	6/13/2024	OOS	8/15/2024	OOS	Testing Required Before Return to Service
PUFSD-0910	Room A121 Home Economics	N/A	Spray Nozzle	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0911	Room A121 Home Economics	N/A	Spray Nozzle	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0912	Guidance Office	N/A	Bottled Water Dispenser (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0913	Custodial Office	N/A	Spray Nozzle	Potable	6/13/2024	OOS	8/15/2024	OOS	Testing Required Before Return to Service

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0547	Women's Bathroom	2013A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0548	Women's Bathroom	2015	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0549	Women's Bathroom	2015	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0550	Women's Bathroom	2015	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0551	Women's Bathroom	2015	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0552	Women's Bathroom	2015	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0555	Old Bathroom Custodial Closet	2042A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0561	Faculty Bathroom	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0562	Custodial Receiving Room Bathroom	1000C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0571	Kitchen	1005	Kitchen Faucet (Cold)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0573	Kitchen Slop Sink	1005H1	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0574	Kitchen Bathroom	1005A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0575	Kitchen Serving Area	1005E	Kitchen Faucet (Cold)	Potable	6/12/2024	5.8	10/18/2024	< 1.0	Outlet Remediated and Returned to Service Continue O&M
PUFSD-0577	Music Suite Men's Bathroom	1001D	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0578	Music Suite Men's Bathroom	1001D	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0579	Auditorium Stage	1003B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0580	Music Suite Girls Bathroom	1001E	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0581	Music Suite Girls Bathroom	1001E	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0582	Men's Bathroom	1065	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0583	Men's Bathroom	1065	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0584	Women's Bathroom	1064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0585	Women's Bathroom	1064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0586	Girl's Bathroom	1063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0587	Girl's Bathroom	1063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0588	Girl's Bathroom	1063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0589	Girl's Bathroom	1063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0590	Girl's Bathroom	1063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0592	Boy's Bathroom	1062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0593	Boy's Bathroom	1062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0594	Boy's Bathroom	1062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0595	Boy's Bathroom	1062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0596	Boy's Bathroom	1062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0597	Room 116	1061	Kitchen Faucet (Cold)	Potable	6/12/2024	4.3			Result Below Action Level Continue O&M
PUFSD-0598	Boy's Bathroom Custodial Closet	1062A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0599	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0600	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0601	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0602	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0603	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0604	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0605	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0606	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0607	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0608	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0609	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0610	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0611	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0612	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0613	Room 119	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0614	Room 119A	1058	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0615	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0616	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0617	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0618	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0619	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0620	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0621	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0622	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0623	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0624	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0625	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0626	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0627	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0628	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0629	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0630	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0631	Room 121	1055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0632	Room 118	1059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0633	Room 118	1059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0634	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0635	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0636	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0637	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0638	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0639	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0640	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0641	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0642	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0643	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0644	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0645	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0646	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0647	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0648	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0649	Room 122	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0650	Boy's Bathroom	1046	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0652	Ice Machine	1052C	Ice Machine	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0653	Ice Machine	1052C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0654	Physical Ed/Health Corridor	1052	Water Fountain-No Chiller	Potable	6/12/2024	1.5			Result Below Action Level Continue O&M
PUFSD-0655	Boy's Locker Room	1049B	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
PUFSD-0656	Boy's Locker Room	1049B	Water Fountain-No Chiller	RFI	6/12/2024	5.7			Outlet Permanently Removed
PUFSD-0657	Boy's Locker Room Bathroom	1049B5	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0658	Boy's Locker Room Bathroom	1049B5	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0659	Boy's Locker Room Bathroom	1049B5	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0661	Gymnasium	1049	Bottle Fill Station	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0662	Gymnasium	1049	Water Cooler	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0663	Room 123	1044	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0664	Room 123	1044	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0665	Art Room 125	1042	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0666	Art Room 125	1042	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0667	Art Room 125	1042	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0668	Art Room 127	1041	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0669	Art Room 127	1041	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0670	Art Room 127	1041	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0671	Room 126	1040	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0672	Room 126	1040	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0673	Room 126	1040	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0674	Room 126	1040	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0675	Room 126	1040	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0676	Room 126A	1038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0677	Room 128	1037	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0678	Room 128	1037	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0679	Room 128	1037	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0680	Room 128	1037	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0681	Room 128	1037	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0682	Art Room 129	1039	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0683	Art Room 129	1039	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0684	Art Room 129	1039	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0685	Art Room 130	1036	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0686	Room 102	1029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0687	Room 102	1029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0688	Room 102	1029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0689	Room 102	1029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0690	Room 102A	1035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0691	Room 104	1028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0692	Room 104	1028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0693	Room 104	1028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0694	Room 104	1028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0695	Room 104	1028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0696	Room 104A	1027	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0697	Room 106	1026	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0698	Room 106	1026	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0699	Room 106	1026	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0700	Room 106	1026	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0701	Room 106	1026	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0712	Old Bathroom Slop Sink Closet	1023B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0713	Faculty Room	1018	Kitchen Faucet (Cold)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0714	Copy Room Bathroom	1017A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0715	Faculty Room Women's Bathroom	1018A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0716	Faculty Room Women's Bathroom	1018A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0717	Nurse's Office	1016	Bottled Water Dispenser (Cold)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0718	Nurse's Office	1016C	Nurse's Office Sink	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0719	Nurse's Office Bathroom	1016A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0720	Room 110	1014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0721	Room 112	1011	Home Economics Faucet (Cold)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0722	Room 112 Bathroom	1011B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0723	Main Office Suite	1007	Water Fountain-No Chiller	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0724	Main Office Suite Womens Bathroom	1007G	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0725	Main Office Suite Mens Bathroom	1007B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0726	Music Suite Girls Bathroom	1001E	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0727	Music Suite Girls Bathroom	1001E	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0728	Administration Office	1024	Kitchen Faucet (Cold)	Potable	6/12/2024	1.3			Result Below Action Level Continue O&M
PUFSD-0729	Administration Office	1024	Bottled Water Dispenser	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0730	Admin. Conference Room Office Bathroom	1021A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0731	Admin. Suite Men's Bathroom	1024D	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0732	Admin. Suite Men's Bathroom	1024D	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0733	Admin. Suite Woman's Bathroom	1024F	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0734	Admin. Suite Woman's Bathroom	1024F	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0735	Admin. Suite Closet 1	1024E	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0736	Admin Faculty Lounge	1024R	Kitchen Faucet (Cold)	Potable	6/12/2024	1.1			Result Below Action Level Continue O&M

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0737	Admin Faculty Lounge	1024R	Bottled Water Dispenser	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0738	Library	1032	Kitchen Faucet (Cold)	Potable	6/12/2024	188	8/30/2024	<1.00 ND	Outlet Remediated and Returned to Service Continue O&M
PUFSD-0739	Library	1032	Kitchen Faucet (Cold)	Potable	6/12/2024	1.6			Result Below Action Level Continue O&M
PUFSD-0740	Board Room Women's Bathroom	1031B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0741	Board Room Men's Bathroom	1031C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0742	Girls Bathroom	1048	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0743	Gym Girls Locker Room	1049A	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
PUFSD-0744	Gym Girls Locker Room Bathroom	1049A2	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0745	Gym Girls Locker Room Bathroom	1049A2	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0746	Gym Girls Locker Room Bathroom	1049A2	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0747	Girls Locker Room Closet	1049A5	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0748	Girls Locker Room Office Bathroom	1049A1B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0749	Boys Locker Room Office	1049B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0750	Board Room Bathroom Vestibule	1031F	Water Cooler	Potable	6/12/2024	1.1			Result Below Action Level Continue O&M
PUFSD-0751	Board Room Closet 2	1031D	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0753	B-1 Boiler Room	0004	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0754	Field House Sports Room	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0755	Field House Women's Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0756	Field House Women's Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0757	Field House	N/A	Bottle Fill Station	Potable	6/12/2024	OOS	8/15/2024	<1.00 ND	Result Below Action Level Continue O&M

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0758	Field House	N/A	Water Fountain-No Chiller	Potable	6/12/2024	OOS	8/15/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0759	Field House Men's Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0760	Field House Men's Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0761	Concession Stand Kitchen	N/A	Kitchen Faucet (Cold)	Potable	6/12/2024	2.9			Result Below Action Level Continue O&M
PUFSD-0762	Concession Stand Kitchen	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0763	Exterior Hose Bib o/s Office- 1	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0764	Exterior Hose Bib o/s Main Office	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0765	Exterior Hose Bib o/s Auditorium	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0766	Exterior Hose Bib o/s Custodial Office	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0767	Exterior Hose Bib o/s Café	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0768	Exterior Hose Bib o/s Café	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0769	Exterior Hose Bib o/s Room 121	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0770	Exterior Hose Bib o/s Girls Locker Room	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0771	Exterior Hose Bib o/s Boys Locker Room	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0772	Exterior Hose Bib o/s Boys Locker Room	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0773	Exterior Hose Bib o/s Room 123	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0774	Exterior Hose Bib o/s Room 129	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0775	Exterior Hose Bib o/s Board Room	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0776	Exterior Hose Bib o/s Admin-8	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0777	Exterior Hose Bib o/s Admin-2	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0781	Room 212 Bathroom	2047	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0787	Cafeteria	1002	Water Cooler	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0788	Cafeteria	1002	Water Cooler	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0789	Cafeteria	1002	Bottle Fill Station	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0790	Corridor Auditorium to Room 124	1066	Water Cooler	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0791	Corridor Auditorium to Room 124	1066	Bottle Fill Station	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0792	Room 110	1014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0793	Lobby Closet (Women's Bathroom)	1069	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0794	Lobby Closet (Women's Bathroom)	1069	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0795	Lobby Closet (Women's Bathroom Vestibule)	1069	Water Fountain-No Chiller	Potable	4/5/2024	OOS	6/12/2024	OOS	Testing Required Before Return to Service
PUFSD-0796	Lobby Closet (Men's Bathroom)	1067	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0797	Lobby Closet (Men's Bathroom Vestibule)	1067	Water Fountain-No Chiller	Potable	4/5/2024	OOS	6/12/2024	OOS	Testing Required Before Return to Service
PUFSD-0798	Kitchen	1005	Kitchen Faucet (Cold)	Potable	4/5/2024	< 1.0	6/12/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0799	Kitchen	1005	Kitchen Faucet (Cold)	Potable	4/5/2024	< 1.0	6/12/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0800	Kitchen	1005	Kitchen Faucet (Cold)	Potable	4/5/2024	1.2	6/12/2024	1.9	Result Below Action Level Continue O&M
PUFSD-0801	Serving Area Kitchen	1004	Kitchen Faucet (Cold)	Potable	4/5/2024	8.5	6/12/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0802	Serving Area Kitchen	1004	Kitchen Faucet (Cold)	Potable	4/5/2024	< 1.0	6/12/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0803	Men's Bathroom	1065	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0804	Men's Bathroom	1065	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0805	Women's Bathroom	1064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0806	Women's Bathroom	1064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0807	Boy's Bathroom	1062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0808	Boy's Bathroom	1062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0809	Boy's Bathroom	1062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0810	Girl's Bathroom	1063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0811	Girl's Bathroom	1063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0812	Girl's Bathroom	1063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0813	Girls Locker Room Coach's Office Bathroom	1049A1B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0814	Girls Locker Room Coach's Office Bathroom	1049A1B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0815	Boys Locker Room Coach's Office Bathroom	1049B1A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0816	Boys Locker Room Coach's Office Bathroom	1049B1A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0817	New Weight Room (Old Fitness Center)	1051	Bottle Fill Station	Potable	4/5/2024	< 1.0	6/12/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0818	New Weight Room (Old Fitness Center)	1051	Water Cooler	Potable	4/5/2024	< 1.0	6/12/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0819	New Weight Room 2nd Floor (Old Fitness Center)	1051	Bottle Fill Station	Potable	4/5/2024	< 1.0	6/12/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0820	New Weight Room 2nd Floor (Old Fitness Center)	1051	Water Cooler	Potable	4/5/2024	< 1.0	6/12/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0821	New Weight Room Bathroom (Old Fitness Center)	1051	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0822	Exterior Hose Bib o/s Room 11	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0878	Admin Office Kitchen Refrigerator	1024	Water Cooler	Potable	6/12/2024	7.4	8/15/2024	1.8	Outlet Remediated and Returned to Service Continue O&M
PUFSD-0879	Admin Office Kitchen Refrigerator	1024	Ice Machine	Potable	6/12/2024	5.8	8/15/2024	<1.00 ND	Outlet Remediated and Returned to Service Continue O&M
PUFSD-0880	Kitchen	1005	Kitchen Faucet (Cold)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M

Plainedge High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0881	Kitchen	1005	Pasta Pot/Steam Kettle	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0882	Concessions Stand Kitchen	N/A	Ice Machine	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0883	Guidance Office	1013E	Bottled Water Dispenser	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0898	Nurse's Office	1016	Bottled Water Dispenser (Hot)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0899	Room 112	1011	Spray Nozzle	Potable	6/12/2024	4.2			Result Below Action Level Continue O&M
PUFSD-0900	Admin Office	1024	Bottled Water Dispenser (Hot)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0901	Admin Faculty Lounge	1024R	Bottled Water Dispenser (Hot)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
PUFSD-0919	Gym	1049	Bottle Fill Station	Potable	10/18/2024	< 1.0			Result Below Action Level Continue O&M
PUFSD-0920	Gym	1049	Water Cooler	Potable	10/18/2024	< 1.0			Result Below Action Level Continue O&M

Brian Moore Athletic Center

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0851	Girls Locker Room Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0852	Boys Locker Room Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0853	Men's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0854	Men's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0855	Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0856	Women's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0857	Women's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0858	Main Lobby	N/A	Water Cooler	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0859	Main Lobby	N/A	Water Cooler	Potable	4/5/2024	< 1.0	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M
PUFSD-0860	Community Room Kitchen	N/A	Kitchen Faucet (Cold)	Potable	4/5/2024	1.3	6/14/2024	1.5	Result Below Action Level Continue O&M
PUFSD-0861	Exterior Hose Bib o/s Gym	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0862	Exterior Hose Bib o/s Community Room	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0877	Community Room Kitchen	N/A	Ice Machine	Potable	4/5/2024	1.4	6/14/2024	<1.00 ND	Result Below Action Level Continue O&M

Transportation Building

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
PUFSD-0867	Meeting/Lunch Room	N/A	Kitchen Faucet (Cold)	Potable	4/5/2024	< 1.0			Result Below Action Level Continue O&M
PUFSD-0868	Meeting/Lunch Room	N/A	Spray Nozzle	Potable	4/5/2024	< 1.0			Result Below Action Level Continue O&M
PUFSD-0869	Meeting/Lunch Room	N/A	Water Cooler	Potable	4/5/2024	< 1.0			Result Below Action Level Continue O&M
PUFSD-0870	Men's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0871	Men's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0872	Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0873	Women's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0874	Women's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0875	Transport Command Center	N/A	Bottled Water Dispenser (Cold)	Potable	4/5/2024	< 1.0			Result Below Action Level Continue O&M
PUFSD-0876	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
PUFSD-0902	Transport Command Center	N/A	Bottled Water Dispenser (Hot)	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M

Attachment 3:

Laboratory Analytical Reports

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395



EC53978



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

Charles E. Schwarting Elementary School

CESES

Client:

Plainedge Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 1 of 2

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0013	LI	N/A	Media Center Room 8 (Library)	KC	6/14/2024	6:23:00 AM
PUFSD-0030	ST	1010	Room 16	KC	6/14/2024	6:19:00 AM
PUFSD-0034	KI	1016B	Kitchen	KC	6/14/2024	6:03:00 AM
PUFSD-0035	KI	1016B	Kitchen	KC	6/14/2024	6:04:00 AM
PUFSD-0038	KI	1016B	Kitchen	SN	6/14/2024	6:05:00 AM
PUFSD-0039	CA	1016	Cafeteria	WF	6/14/2024	6:07:00 AM
PUFSD-0040	CA	1016	Cafeteria	WC	6/14/2024	6:08:00 AM
PUFSD-0041	NO	1018A	Nurse's Office	NS	6/14/2024	6:09:00 AM
PUFSD-0043	FL	1021	Faculty Lounge	KC	6/14/2024	6:09:00 AM
PUFSD-0072	HA	1052	Corridor Room 37 to Elevator	WC	6/14/2024	6:13:00 AM
PUFSD-0090	HA	2012	Corridor Room 44 to Room 52	DW	6/14/2024	6:15:00 AM
PUFSD-0105	HA	2012	Corridor Room 44 to Room 52	WC	6/14/2024	6:16:00 AM
PUFSD-0778	OF	1013C	Main Office Principal's Office	BW	6/14/2024	6:20:00 AM
PUFSD-0779	KI	1016B	Kitchen	KC	6/14/2024	6:05:00 AM
PUFSD-0780	KI	1016B	Kitchen	PK	6/14/2024	6:06:00 AM
PUFSD-0823	HA	1042	Corridor Girls Bathroom to Room 34	WF	6/14/2024	6:11:00 AM
PUFSD-0824	HA	1042	Corridor Girls Bathroom to Room 34	WC	6/14/2024	6:11:00 AM
PUFSD-0834	KI	1016B	Kitchen	KC	6/14/2024	6:06:00 AM

Building Address

1 Flower Road

Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received:

Signature: *A. Minnifield*

6/14/24 1:01 PM

Samplers Name: Anthony Lombardo

Samplers Signature:

JCB Project Manager: LOMBARDO



EC53978



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

Charles E. Schwarting Elementary School

CESES

Client:

Plainedge Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush _____

Page 2 of 2

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0835	KI	1016B	Kitchen	KC	6/14/2024	6:06:00 AM
PUFSD-0914	OF	1013C	Main Office Principal's Office	BWH	6/14/2024	6:20:00 AM
PUFSD-0915	LI	N/A	Media Center Room 8 (Library)	SN	6/14/2024	6:24:00 AM

Samples Submitted 21

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 14 P 1:01

Building Address

1 Flower Road

Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received: A. MinnifiedSignature: A. Minnified

6/14/24 1:01pm

Samplers Name: Anthony LombardoSamplers Signature: (Signature)JCB Project Manager: LOMBARDO

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453978
LIMS Reference ID: EC53978
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: 23-53781, Charles E. Schwarting Elementary
School CESES, Plainedge Union Free School
District, 1 Flower Road Massapequa, NY 11758
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:01
Reported: 07/03/2024 12:15

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD- 0013 Lims Reference ID: EC53978-01 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	06/26/24 15:10	06/26/24 15:10	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0030 Lims Reference ID: EC53978-02 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	31.7		1	1.0	µg/L	06/26/24 15:26	06/26/24 15:26	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0034 Lims Reference ID: EC53978-03 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	18.2		1	1.0	µg/L	06/26/24 15:31	06/26/24 15:31	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0035 Lims Reference ID: EC53978-04 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	3.0		1	1.0	µg/L	06/26/24 15:32	06/26/24 15:32	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0038 Lims Reference ID: EC53978-05 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	20.6		1	1.0	µg/L	06/26/24 15:34	06/26/24 15:34	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0039 Lims Reference ID: EC53978-06 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:35	06/26/24 15:35	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0040 Lims Reference ID: EC53978-07 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:39	06/26/24 15:39	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0041 Lims Reference ID: EC53978-08 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:41	06/26/24 15:41	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0043 Lims Reference ID: EC53978-09 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:42	06/26/24 15:42	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453978
LIMS Reference ID: EC53978
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: 23-53781, Charles E. Schwarting Elementary
School CESES, Plainedge Union Free School
District, 1 Flower Road Massapequa, NY 11758
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:01
Reported: 07/03/2024 12:15

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD- 0072 Lims Reference ID: EC53978-10 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:44	06/26/24 15:44	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0090 Lims Reference ID: EC53978-11 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:45	06/26/24 15:45	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0105 Lims Reference ID: EC53978-12 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:47	06/26/24 15:47	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0778 Lims Reference ID: EC53978-13 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:51	06/26/24 15:51	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0779 Lims Reference ID: EC53978-14 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	2.1		1	1.0	µg/L	06/26/24 15:52	06/26/24 17:11	JH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0780 Lims Reference ID: EC53978-15 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	06/26/24 15:57	06/26/24 15:57	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0823 Lims Reference ID: EC53978-16 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:58	06/26/24 15:58	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0824 Lims Reference ID: EC53978-17 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 16:00	06/26/24 16:00	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0834 Lims Reference ID: EC53978-18 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 16:01	06/26/24 16:01	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453978**LIMS Reference ID:** EC53978**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, Charles E. Schwarting Elementary
School CESES, Plainedge Union Free School
District, 1 Flower Road Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:01

Reported:

07/03/2024 12:15

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD- 0835 Lims Reference ID: EC53978-19 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 16:02	06/26/24 16:02	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0914 Lims Reference ID: EC53978-20 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 16:04	06/26/24 16:04	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD- 0915 Lims Reference ID: EC53978-21 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 16:05	06/26/24 16:05	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453978**LIMS Reference ID:** EC53978**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, Charles E. Schwarting Elementary
School CESES, Plainedge Union Free School
District, 1 Flower Road Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:01

Reported:

07/03/2024 12:15

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453978**LIMS Reference ID:** EC53978**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, Charles E. Schwarting Elementary
School CESES, Plainedge Union Free School
District, 1 Flower Road Massapequa, NY 11758

Customer PO:

Jeromy Bish

EMSL Sales Rep:**Received:**

06/14/2024 13:01

Reported:

07/03/2024 12:15

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

Charles E. Schwarting Elementary School

CESES

EC55590

Client:

Plainedge Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Courier

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0034	KI	1016B	Kitchen	KC	8/15/2024	7:47:00 AM

Samples Submitted 1

RECEIVED
EHS ANALYTICAL, INC.
CARLE PLACE, NY
2024 AUG 16 P 12:52

Building Address

1 Flower Road
Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received:

Signature:

8/16/24 / 12:52 pm

Samplers Name: Conor Malansky

Samplers Signature: Conor Malansky

JCB Project Manager: Anthony Lombardo



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062455590
LIMS Reference ID: EC55590
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: #23-53781, Charles E. Schwarting Elementary School, CESES, Plainedge Union Free School District, 1 Flower Road Massapequa, NY 11758
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 08/16/2024 12:52
Reported: 08/20/2024 11:57

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0034 Lims Reference ID: EC55590-01 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	08/18/24 16:49	08/18/24 16:49	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455590**LIMS Reference ID:** EC55590**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Charles E. Schwarting Elementary
School, CESES, Plainedge Union Free School
District, 1 Flower Road Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:52

Reported:

08/20/2024 11:57

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455590**LIMS Reference ID:** EC55590**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Charles E. Schwarting Elementary
School, CESES, Plainedge Union Free School
District, 1 Flower Road Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:52

Reported:

08/20/2024 11:57


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

Eastplain Elementary School

EES

Client:

Plainedge Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0159	NO	1018	Health Office Room 19	NS	6/14/2024	6:37:00 AM
PUFSD-0161	KI	1021A	Kitchen	KC	6/14/2024	6:38:00 AM
PUFSD-0164	KI	1021A	Kitchen	KC	6/14/2024	6:38:00 AM
PUFSD-0165	CA	1022	Cafeteria	WF	6/14/2024	6:42:00 AM
PUFSD-0166	CA	1022	Cafeteria	WC	6/14/2024	6:43:00 AM
PUFSD-0167	FL	1025A	Faculty Room 23 Kichinette	KC	6/14/2024	6:44:00 AM
PUFSD-0169	HA	1028	Corridor Men's Bathroom to Gym	WC	6/14/2024	6:45:00 AM
PUFSD-0170	HA	1028	Corridor Men's Bathroom to Gym	DW	6/14/2024	6:45:00 AM
PUFSD-0838	HA	1014	Corridor Room 7 to Room 17	WF	6/14/2024	6:47:00 AM
PUFSD-0839	HA	1014	Corridor Room 7 to Room 17	WC	6/14/2024	6:48:00 AM
PUFSD-0885	KI	1021A	Kitchen	PK	6/14/2024	6:40:00 AM
PUFSD-0886	KI	1021A	Kitchen	KC	6/14/2024	6:39:00 AM

Samples Submitted

12

RECEIVED
ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 14 P 1:00

Counter

Building Address

301 North Delaware Avenue

Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received:

A. Minnifield

Signature:

A. Minnifield

6/14/24 1:00pm

Samplers Name: Anthony Lombardo

Samplers Signature:

[Signature]

JCB Project Manager:

LOMBARDO

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453979
LIMS Reference ID: EC53979
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: #25-53781, Eastplain Elementary School, EES,
Plainedge Union Free School District, 301
North Delaware Avenue Massapequa NY
11758
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:00
Reported: 07/03/2024 11:52

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0159 Lims Reference ID: EC53979-01 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:23	06/27/24 15:23	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0161 Lims Reference ID: EC53979-02 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:31	06/27/24 15:31	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0164 Lims Reference ID: EC53979-03 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	4.7		1	1.0	µg/L	06/27/24 15:32	06/27/24 15:32	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0165 Lims Reference ID: EC53979-04 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:33	06/27/24 15:33	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0166 Lims Reference ID: EC53979-05 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:35	06/27/24 15:35	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0167 Lims Reference ID: EC53979-06 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:36	06/27/24 15:36	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0169 Lims Reference ID: EC53979-07 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:38	06/27/24 15:38	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0170 Lims Reference ID: EC53979-08 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:39	06/27/24 15:39	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0838 Lims Reference ID: EC53979-09 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:41	06/27/24 15:41	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453979**LIMS Reference ID:** EC53979**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#25-53781, Eastplain Elementary School, EES,
Plainedge Union Free School District, 301
North Delaware Avenue Massapequa NY
11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:00

Reported:

07/03/2024 11:52

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0839 Lims Reference ID: EC53979-10 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:45	06/27/24 15:45	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0885 Lims Reference ID: EC53979-11 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:46	06/27/24 15:46	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0886 Lims Reference ID: EC53979-12 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:51	06/27/24 15:51	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453979**LIMS Reference ID:** EC53979**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#25-53781, Eastplain Elementary School, EES,
Plainedge Union Free School District, 301
North Delaware Avenue Massapequa NY
11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:00

Reported:

07/03/2024 11:52

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453979**LIMS Reference ID:** EC53979**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#25-53781, Eastplain Elementary School, EES,
Plainedge Union Free School District, 301
North Delaware Avenue Massapequa NY
11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:00

Reported:

07/03/2024 11:52

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building: John H. West Elementary School

JHWES

Client:

Plainedge Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

EC53976

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0225	LI	N/A	Media Center Room 12 (Library)	KC	6/14/2024	7:24:00 AM
PUFSD-0247	HA	1026	Corridor Room 19 to Girls Bathroom	WC	6/14/2024	7:12:00 AM
PUFSD-0253	OF	1010	Custodian Office Room 32	BWC	6/14/2024	7:14:00 AM
PUFSD-0284	HA	2014	Corridor Room 49 to Room 42	WC	6/14/2024	7:19:00 AM
PUFSD-0289	NO	1012	Nurse's Office	NS	6/14/2024	7:11:00 AM
PUFSD-0291	FL	1027A	Faculty Lounge	KC	6/14/2024	7:09:00 AM
PUFSD-0296	KI	1030	Kitchen	KC	6/14/2024	7:06:00 AM
PUFSD-0297	KI	1030	Kitchen	KC	6/14/2024	7:04:00 AM
PUFSD-0298	KI	1030	Kitchen	KC	6/14/2024	7:03:00 AM
PUFSD-0844	CA	1029	Cafeteria	WF	6/14/2024	7:02:00 AM
PUFSD-0845	CA	1029	Cafeteria	WC	6/14/2024	7:03:00 AM
PUFSD-0846	KI	1030	Kitchen	KC	6/14/2024	7:03:00 AM
PUFSD-0847	KI	1030	Kitchen	PK	6/14/2024	7:07:00 AM
PUFSD-0848	HA	1047	Corridor Room 8 to Room 14	WF	6/14/2024	7:00:00 AM
PUFSD-0849	HA	1047	Corridor Room 8 to Room 14	WC	6/14/2024	7:01:00 AM
PUFSD-0888	KI	N/A	Bobcat Snack Shack Kitchen	KC	6/14/2024	7:35:00 AM
PUFSD-0889	KI	N/A	Bobcat Snack Shack Kitchen	SN	6/14/2024	7:35:00 AM
PUFSD-0917	OF	1010	Custodian Office Room 32	BWH	6/14/2024	7:15:00 AM

Building Address

499 Boundary Avenue

Bethpage, NY 11714

Analysis Type: ELAP 200.5

Lab Received: A. Minnified


Signature: A. Minnified


6/14/24 1:01 PM

Samplers Name: Anthony Lombardo

Samplers Signature: (Signature)

JCB Project Manager: LOMBARDO





Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building: John H. West Elementary School

JHWES

Client:

Plainedge Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0918	LI	N/A	Media Center Room 12 (Library)	SN	6/14/2024	7:25:00 AM

Samples Submitted 19

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 14 P 1:01

Building Address

499 Boundary Avenue

Bethpage, NY 11714

Analysis Type: ELAP 200.5

Lab Received: A. Minnifield

Signature: A. Minnifield
6/14/24 1:01pm

Samplers Name: Anthony Lombardo

Samplers Signature: (Signature)

JCB Project Manager: LOMBARDO

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453976
LIMS Reference ID: EC53976
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: 23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue Bethpage, NY 11714
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:01
Reported: 07/03/2024 12:06

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0225 Lims Reference ID: EC53976-01 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:31	06/26/24 14:31	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0247 Lims Reference ID: EC53976-02 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:35	06/26/24 14:35	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0253 Lims Reference ID: EC53976-03 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:36	06/26/24 14:36	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0284 Lims Reference ID: EC53976-04 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:38	06/26/24 14:38	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0289 Lims Reference ID: EC53976-05 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:39	06/26/24 14:39	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0291 Lims Reference ID: EC53976-06 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:44	06/26/24 14:44	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0296 Lims Reference ID: EC53976-07 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	14.3		1	1.0	µg/L	06/26/24 14:45	06/26/24 14:45	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0297 Lims Reference ID: EC53976-08 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:47	06/26/24 14:47	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0298 Lims Reference ID: EC53976-09 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:48	06/26/24 14:48	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453976
LIMS Reference ID: EC53976
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: 23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue Bethpage, NY 11714
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:01
Reported: 07/03/2024 12:06

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0844 Lims Reference ID: EC53976-10 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:49	06/26/24 14:49	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0845 Lims Reference ID: EC53976-11 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:51	06/26/24 14:51	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0846 Lims Reference ID: EC53976-12 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:55	06/26/24 14:55	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0847 Lims Reference ID: EC53976-13 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 14:57	06/26/24 17:13	JH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0848 Lims Reference ID: EC53976-14 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:01	06/26/24 15:01	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0849 Lims Reference ID: EC53976-15 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:02	06/26/24 15:02	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0888 Lims Reference ID: EC53976-16 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:04	06/26/24 15:04	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0889 Lims Reference ID: EC53976-17 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:05	06/26/24 15:05	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0917 Lims Reference ID: EC53976-18 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 15:07	06/26/24 15:07	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453976**LIMS Reference ID:** EC53976**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue Bethpage, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:01

Reported:

07/03/2024 12:06

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453976**LIMS Reference ID:** EC53976**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue Bethpage, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:01

Reported:

07/03/2024 12:06


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

John H. West Elementary School

JHWES

Courier

Client:

Plainedge Union Free School District

~~Retest~~ New Install ☐

Turn Around: Normal 1 wk Rush ☐

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0296	KI	1030	Kitchen	KC	8/15/2024	8:06:00 AM

Samples Submitted 1

EC 55592

RECEIVED
EHS ANALYTICAL, INC.
CARLE PLACE, NY
2024 AUG 16 P 12:54

Pb 200.8 SFA 8/20/24

Building Address

499 Boundary Avenue

Bethpage, NY 11714

Analysis Type: ELAP 200.5

Lab Received: A. Minnifield

Signature: A. Minnifield
8/16/24 12:54 pm

Samplers Name: Conor Maloney

Samplers Signature: Conor Maloney

JCB Project Manager: Anthony Lombardo

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455592

LIMS Reference ID: EC55592

EMSL Customer ID: JCBR50

Attention: Anthony Lombardo

J.C. Broderick & Associates [JC BR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue, Bethpage, NY 11714

Customer PO:

Jeromy Bish

EMSL Sales Rep:

08/16/2024 12:54

Received:

08/20/2024 12:29

Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	--------------------	--------------------	------------------	-------------------------

Sample: PUFSD-0296

Lims Reference ID: EC55592-01 Matrix: Drinking Water

Sampled: 08/15/24 00:00:00

Metals

Lead	34.3	1	1.0	µg/L	08/20/24 10:57	08/20/24 10:57	SEH	EPA 200.8 (Dig)/EPA 200.8
------	------	---	-----	------	----------------	----------------	-----	---------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455592**LIMS Reference ID:** EC55592**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue, Bethpage, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:54

Reported:

08/20/2024 12:29

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455592**LIMS Reference ID:** EC55592**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue, Bethpage, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:54

Reported:

08/20/2024 12:29

Notes and Definitions


Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

EC55906

**Lead in Water: Chain of Custody for**

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

John H. West Elementary School

JHWES

Client:

Plainedge Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0296	KI	1030	Kitchen	KC	8/30/2024	7:36:00 AM

Samples Submitted 1

Courier

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 30 2024 PM12:48

Building Address

499 Boundary Avenue

Bethpage, NY 11714

Analysis Type: ELAP 200.5**Lab Received:****Signature:****Samplers Name:** Anthony Lombardo**Samplers Signature:****JCB Project Manager:** LOMBARDO

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455906

LIMS Reference ID: EC55906

EMSL Customer ID: JCBR50

Attention: Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue Bethpage, NY 11714

Customer PO:

Jeromy Bish

EMSL Sales Rep:

08/30/2024 12:48

Received:

08/31/2024 17:10

Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: PUFSD- 0296

Lims Reference ID: EC55906-01 Matrix: Drinking Water

Sampled: 08/30/24 00:00:00

Metals

Lead	28.5	1	1.0	µg/L	08/31/24 16:46	08/31/24 16:46	JH	EPA 200.8 (Dig)/EPA 200.8
------	------	---	-----	------	----------------	----------------	----	---------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455906**LIMS Reference ID:** EC55906**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue Bethpage, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/30/2024 12:48

Reported:

08/31/2024 17:10

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455906**LIMS Reference ID:** EC55906**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, John H. West Elementary School,
JHWES, Plainedge Union Free School District,
499 Boundary Avenue Bethpage, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/30/2024 12:48

Reported:

08/31/2024 17:10

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

John H. West Elementary School

JHWES

EC57053

Client:

Plainedge Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 1

Courier

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0296	KI	1030	Kitchen	KC	10/18/2024	7:05:00 AM

Samples Submitted 1

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
OCT 18 2024 PM12:38

Pb 200 884 10/23/24

Building Address

499 Boundary Avenue

Bethpage, NY 11714

Analysis Type: ELAP 200.5

Lab Received:

Signature:

A. Minnifield

[Signature]

Samplers Name:

Anthony Lombardo

Samplers Signature:

[Signature]

JCB Project Manager:

LOMBARDO

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062457053

LIMS Reference ID: EC57053

EMSL Customer ID: JCBR50

Attention: Anthony Lombardo

J.C. Broderick & Associates [JC BR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781 , John H. West Elementary School,
JHWES, Plainedge Union Free School District,
490 Boundary Avenue Bethpage, NY 11714

Customer PO:

EMSL Sales Rep:

Jeromy Bish

Received:

10/18/2024 12:38

Reported:

10/23/2024 16:00

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	--------------------	--------------------	------------------	-------------------------

Sample: PUFSD- 0296

Lims Reference ID: EC57053-01 Matrix: Drinking Water

Sampled: 10/18/24 00:00:00

Metals

Lead	< 1.0	1	1.0	µg/L	10/23/24 13:47	10/23/24 13:47	SEH	EPA 200.8 (Dig)/EPA 200.8
------	-------	---	-----	------	----------------	----------------	-----	---------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062457053**LIMS Reference ID:** EC57053**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781 , John H. West Elementary School,
JHWES, Plainedge Union Free School District,
490 Boundary Avenue Bethpage, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

10/18/2024 12:38

Reported:

10/23/2024 16:00

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062457053**LIMS Reference ID:** EC57053**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781 , John H. West Elementary School,
JHWES, Plainedge Union Free School District,
490 Boundary Avenue Bethpage, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

10/18/2024 12:38

Reported:

10/23/2024 16:00


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

Plainedge Middle School

PMS

Client:

Plainedge Union Free School District

Retest/New Install: ☒

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0320	BR	N/A	Hallway/s Room C307	WC	6/13/2024	5:51:00 AM
PUFSD-0330	HA	N/A	Hallway o/s Room C339	DW	6/13/2024	5:49:00 AM
PUFSD-0331	HA	N/A	Hallway o/s Room C339	DW	6/13/2024	5:49:00 AM
PUFSD-0368	HA	N/A	Hallway o/s Room C223	WC	6/13/2024	5:56:00 AM
PUFSD-0403	HA	N/A	Hallway o/s C205	WC	6/13/2024	5:59:00 AM
PUFSD-0404	HA	N/A	Hallway o/s C205	WC	6/13/2024	5:59:00 AM
PUFSD-0437	OF	N/A	Custodial Office	KC	6/13/2024	6:06:00 AM
PUFSD-0440	CA	N/A	Cafeteria	WC	6/13/2024	5:04:00 AM
PUFSD-0441	CA	N/A	Cafeteria	WF	6/13/2024	5:02:00 AM
PUFSD-0442	CA	N/A	Cafeteria	WC	6/13/2024	5:03:00 AM
PUFSD-0443	SA	N/A	Kitchen Serving Line	KC	6/13/2024	5:06:00 AM
PUFSD-0444	SA	N/A	Kitchen Serving Line	KC	6/13/2024	5:06:00 AM
PUFSD-0445	KI	N/A	Kitchen	KC	6/13/2024	5:13:00 AM
PUFSD-0446	KI	N/A	Kitchen	KC	6/13/2024	5:12:00 AM
PUFSD-0447	KI	N/A	Kitchen	KC	6/13/2024	5:12:00 AM
PUFSD-0448	KI	N/A	Kitchen	KC	6/13/2024	5:11:00 AM
PUFSD-0449	KI	N/A	Kitchen	KC	6/13/2024	5:11:00 AM
PUFSD-0450	KI	N/A	Kitchen	KC	6/13/2024	5:08:00 AM

Building Address

200 Stewart Avenue

Plainedge, NY 11714

Analysis Type: ELAP 200.5


Lab Received: _____

Signature: _____

Samplers Name: Conor Malanophy

Samplers Signature: CM

JCB Project Manager: Anthony Lombardo



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53781
Building: Plainedge Middle School
PMS

Client:
Plainedge Union Free School District

Retest/New Install [-]
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0451	KI	N/A	Kitchen	KC	6/13/2024	5:07:00 AM
PUFSD-0452	KI	N/A	Kitchen	KC	6/13/2024	5:10:00 AM
PUFSD-0453	KI	N/A	Kitchen	KC	6/13/2024	5:10:00 AM
PUFSD-0454	KI	N/A	Kitchen	PK	6/13/2024	5:08:00 AM
PUFSD-0457	NO	N/A	Student Health Services A118	NS	6/13/2024	5:21:00 AM
PUFSD-0459	NO	N/A	Student Health Services A118	NS	6/13/2024	5:21:00 AM
PUFSD-0460	OF	N/A	Media Center/Library Office	KC	6/13/2024	5:26:00 AM
PUFSD-0461	HE	N/A	Room A121 Home Economics	EC	6/13/2024	5:29:00 AM
PUFSD-0462	HE	N/A	Room A121 Home Economics	EC	6/13/2024	5:28:00 AM
PUFSD-0464	HA	N/A	Hallway o/s Faculty Women's Bathroom A123	WC	6/13/2024	5:32:00 AM
PUFSD-0465	HA	N/A	Hallway o/s Faculty Women's Bathroom A123	WC	6/13/2024	5:32:00 AM
PUFSD-0468	FL	N/A	Room C110	KC	6/13/2024	5:34:00 AM
PUFSD-0469	OF	N/A	Main Office	KC	6/13/2024	5:35:00 AM
PUFSD-0470	OF	N/A	Guidance Office	KC	6/13/2024	5:36:00 AM
PUFSD-0476	HA	N/A	Auditorium Lobby Hallway	WC	6/13/2024	5:39:00 AM
PUFSD-0477	HA	N/A	Auditorium Lobby Hallway	WC	6/13/2024	5:39:00 AM
PUFSD-0499	HA	N/A	Hallway o/s Gym	WF	6/13/2024	5:42:00 AM
PUFSD-0500	HA	N/A	Hallway o/s Gym	WC	6/13/2024	5:42:00 AM

Building Address

200 Stewart Avenue
Plainedge, NY 11714

Analysis Type: ELAP 200.5


Lab Received: _____

Signature: _____

Samplers Name: Conor Malanaphy

Samplers Signature: CM

JCB Project Manager: Anthony Lombardo



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building: Plainedge Middle School

PMS

Client:

Plainedge Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0515	HA	N/A	Hallway o/s Cafeteria	WC	6/13/2024	5:20:00 AM
PUFSD-0516	HA	N/A	Hallway o/s Cafeteria	WC	6/13/2024	5:20:00 AM
PUFSD-0521	HE	N/A	Room A111 Family and Consumer Science	EC	6/13/2024	5:14:00 AM
PUFSD-0522	HE	N/A	Room A111 Family and Consumer Science	EC	6/13/2024	5:15:00 AM
PUFSD-0523	HE	N/A	Room A111 Family and Consumer Science	EC	6/13/2024	5:15:00 AM
PUFSD-0524	HE	N/A	Room A111 Family and Consumer Science	EC	6/13/2024	5:18:00 AM
PUFSD-0525	OF	N/A	Basement Custodial Office/Lounge	KC	6/13/2024	6:03:00 AM
PUFSD-0784	HA	N/A	Hallway o/s Room C307	WC	6/13/2024	5:51:00 AM
PUFSD-0786	HA	N/A	Hallway o/s Room C307	WF	6/13/2024	5:51:00 AM
PUFSD-0863	HA	N/A	2nd Floor Hallway o/s Room C223	WF	6/13/2024	5:57:00 AM
PUFSD-0864	HA	N/A	2nd Floor Hallway o/s Room C223	WC	6/13/2024	5:57:00 AM
PUFSD-0894	KI	N/A	Kitchen	PK	6/13/2024	5:09:00 AM
PUFSD-0896	OF	N/A	Guidance Office	BW	6/13/2024	5:37:00 AM
PUFSD-0903	HE	N/A	Room A111 Family and Consumer Science	SN	6/13/2024	5:16:00 AM
PUFSD-0904	HE	N/A	Room A111 Family and Consumer Science	SN	6/13/2024	5:16:00 AM
PUFSD-0905	HE	N/A	Room A111 Family and Consumer Science	SN	6/13/2024	5:17:00 AM
PUFSD-0906	HE	N/A	Room A111 Family and Consumer Science	SN	6/13/2024	5:18:00 AM
PUFSD-0907	NO	N/A	Student Health Services A118	SN	6/13/2024	5:22:00 AM

Building Address

200 Stewart Avenue

Plainedge, NY 11714

Analysis Type: ELAP 200.5

Lab Received: _____

Signature: _____

Samplers Name: Conor Malenaphy

Samplers Signature: [Signature]

JCB Project Manager: Anthony Lombardo



TEL: (631) 584-5492 FAX: (631) 584-3395

PMS

Turn Around: Normal 1 wk Rush

JCB Project Manager: Anthony Lombardo

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957
LIMS Reference ID: EC53957
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:02
Reported: 07/05/2024 13:26

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0320 Lims Reference ID: EC53957-01 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:20	06/27/24 15:20	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0330 Lims Reference ID: EC53957-02 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:24	06/27/24 15:24	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0331 Lims Reference ID: EC53957-03 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:26	06/27/24 15:26	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0368 Lims Reference ID: EC53957-04 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:30	06/27/24 15:30	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0403 Lims Reference ID: EC53957-05 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:31	06/27/24 15:31	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0404 Lims Reference ID: EC53957-06 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:32	06/27/24 15:32	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0437 Lims Reference ID: EC53957-07 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:33	06/27/24 15:33	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0440 Lims Reference ID: EC53957-08 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:35	06/27/24 15:35	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0441 Lims Reference ID: EC53957-09 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:36	06/27/24 15:36	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957**LIMS Reference ID:** EC53957**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/05/2024 13:26

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0442 Lims Reference ID: EC53957-10 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:37	06/27/24 15:37	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0443 Lims Reference ID: EC53957-11 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	2.4		1	1.0	µg/L	06/27/24 15:39	06/27/24 15:39	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0444 Lims Reference ID: EC53957-12 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	2.4		1	1.0	µg/L	06/27/24 15:45	06/27/24 15:45	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0445 Lims Reference ID: EC53957-13 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:47	06/27/24 17:16	JH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0446 Lims Reference ID: EC53957-14 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:48	06/27/24 15:48	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0447 Lims Reference ID: EC53957-15 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:49	06/27/24 15:49	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0448 Lims Reference ID: EC53957-16 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:51	06/27/24 15:51	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0449 Lims Reference ID: EC53957-17 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	7.2		1	1.0	µg/L	06/27/24 15:52	06/27/24 15:52	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0450 Lims Reference ID: EC53957-18 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	4.9		1	1.0	µg/L	06/27/24 15:53	06/27/24 15:53	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957
LIMS Reference ID: EC53957
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:02
Reported: 07/05/2024 13:26

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0451 Lims Reference ID: EC53957-19 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	2.4		1	1.0	µg/L	06/27/24 15:55	06/27/24 15:55	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0452 Lims Reference ID: EC53957-20 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 15:56	06/27/24 15:56	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0453 Lims Reference ID: EC53957-21 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	68.5		1	1.0	µg/L	06/27/24 16:16	06/27/24 16:16	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0454 Lims Reference ID: EC53957-22 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	1.3		1	1.0	µg/L	06/27/24 16:20	06/27/24 16:20	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0457 Lims Reference ID: EC53957-23 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:22	06/27/24 16:22	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0459 Lims Reference ID: EC53957-24 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	06/27/24 16:26	06/27/24 16:26	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0460 Lims Reference ID: EC53957-25 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:27	06/27/24 16:27	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0461 Lims Reference ID: EC53957-26 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:28	06/27/24 16:28	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0462 Lims Reference ID: EC53957-27 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:29	06/27/24 16:29	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957
LIMS Reference ID: EC53957
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:02
Reported: 07/05/2024 13:26

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0464 Lims Reference ID: EC53957-28 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:31	06/27/24 16:31	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0465 Lims Reference ID: EC53957-29 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:32	06/27/24 16:32	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0468 Lims Reference ID: EC53957-30 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	2.5		1	1.0	µg/L	06/27/24 16:33	06/27/24 16:33	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0469 Lims Reference ID: EC53957-31 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:35	06/27/24 16:35	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0470 Lims Reference ID: EC53957-32 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:41	06/27/24 16:41	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0476 Lims Reference ID: EC53957-33 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:43	06/27/24 16:43	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0477 Lims Reference ID: EC53957-34 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:44	06/27/24 16:44	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0499 Lims Reference ID: EC53957-35 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:45	06/27/24 16:45	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0500 Lims Reference ID: EC53957-36 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:47	06/27/24 16:47	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957**LIMS Reference ID:** EC53957**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/05/2024 13:26

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0515 Lims Reference ID: EC53957-37 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:48	06/27/24 16:48	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0516 Lims Reference ID: EC53957-38 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:49	06/27/24 16:49	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0521 Lims Reference ID: EC53957-39 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:51	06/27/24 16:51	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0522 Lims Reference ID: EC53957-40 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 16:52	06/27/24 16:52	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0523 Lims Reference ID: EC53957-41 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:18	06/27/24 09:18	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0524 Lims Reference ID: EC53957-42 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:25	06/27/24 09:25	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0525 Lims Reference ID: EC53957-43 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:26	06/27/24 09:26	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0784 Lims Reference ID: EC53957-44 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:28	06/27/24 09:28	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0786 Lims Reference ID: EC53957-45 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:29	06/27/24 09:29	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957
LIMS Reference ID: EC53957
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:02
Reported: 07/05/2024 13:26

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0863 Lims Reference ID: EC53957-46 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:31	06/27/24 09:31	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0864 Lims Reference ID: EC53957-47 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:32	06/27/24 09:32	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0894 Lims Reference ID: EC53957-48 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	19.7		1	1.0	µg/L	06/27/24 09:34	06/27/24 09:34	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0896 Lims Reference ID: EC53957-49 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:35	06/27/24 09:35	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0903 Lims Reference ID: EC53957-50 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:39	06/27/24 09:39	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0904 Lims Reference ID: EC53957-51 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:41	06/27/24 09:41	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0905 Lims Reference ID: EC53957-52 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:45	06/27/24 09:45	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0906 Lims Reference ID: EC53957-53 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:47	06/27/24 09:47	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0907 Lims Reference ID: EC53957-54 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	11.1		1	1.0	µg/L	06/27/24 09:48	06/27/24 09:48	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957**LIMS Reference ID:** EC53957**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/05/2024 13:26

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0908 Lims Reference ID: EC53957-55 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:49	06/27/24 09:49	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0910 Lims Reference ID: EC53957-56 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:51	06/27/24 09:51	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0911 Lims Reference ID: EC53957-57 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:52	06/27/24 09:52	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0912 Lims Reference ID: EC53957-58 Matrix: Drinking Water Sampled: 06/13/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:57	06/27/24 09:57	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957**LIMS Reference ID:** EC53957**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:

Jeromy Bish

EMSL Sales Rep:**Received:**

06/14/2024 13:02

Reported:

07/05/2024 13:26

Work Order Case Narrative

Note: MS/MSD had analyte outside of our specification range and was not evaluated

Report Amended 7/5/2024 13:30 replacing report from 7/3/2024 12:19 - Reason: Sample Dates amended

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957**LIMS Reference ID:** EC53957**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/05/2024 13:26

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453957**LIMS Reference ID:** EC53957**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/05/2024 13:26

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building: Plainedge Middle School

PMS

Courier

Client:

Plainedge Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0449	KI	N/A	Kitchen	KC	8/15/2024	8:45:00 AM
PUFSD-0894	KI	N/A	Kitchen	PK	8/15/2024	8:46:00 AM
PUFSD-0907	NO	N/A	Student Health Services A118	SN	8/15/2024	8:48:00 AM

Samples Submitted 3

EC55587

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 AUG 16 P 12:54

Pb 200.8 *SA* 8/18/24

Building Address

200 Stewart Avenue

Plainedge, NY 11714

Analysis Type: ELAP 200.5

Lab Received: *A. Minnifield*

Signature: *A. Minnifield*
8/16/24 12:54pm

Samplers Name: _____

Samplers Signature: _____

JCB Project Manager: _____

Page 4 of 4

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455587**LIMS Reference ID:** EC55587**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge Middle School, PMS,
Plainedge Union Free School District, 200
Stewart Avenue Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:54

Reported:

08/20/2024 11:53

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0449 Lims Reference ID: EC55587-01 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	116		3	3.0	µg/L	08/18/24 16:08	08/18/24 16:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0894 Lims Reference ID: EC55587-02 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	11.3		1	1.0	µg/L	08/18/24 16:09	08/18/24 16:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0907 Lims Reference ID: EC55587-03 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	7.9		1	1.0	µg/L	08/18/24 16:10	08/18/24 16:10	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455587**LIMS Reference ID:** EC55587**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge Middle School, PMS,
Plainedge Union Free School District, 200
Stewart Avenue Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:54

Reported:

08/20/2024 11:53

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455587**LIMS Reference ID:** EC55587**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge Middle School, PMS,
Plainedge Union Free School District, 200
Stewart Avenue Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:54

Reported:

08/20/2024 11:53


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory


EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53781
Building: Plainedge Middle School
PMS



EC55907

Client:
Plainedge Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0449	KI	N/A	Kitchen	KC	8/30/2024	7:23:00 AM
PUFSD-0894	KI	N/A	Kitchen	PK	8/30/2024	7:24:00 AM
PUFSD-0907	NO	N/A	Student Health Services A118	SN	8/30/2024	7:26:00 AM

Samples Submitted 3

8/31/24
JL
800-8

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 30 2024 PM12:46

Building Address
200 Stewart Avenue
Plainedge, NY 11714

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Anthony Lombardo

Samplers Signature:

JCB Project Manager: LOMBARDO

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455907**LIMS Reference ID:** EC55907**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB#: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/30/2024 12:46

Reported:

08/31/2024 17:11

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0449 Lims Reference ID: EC55907-01 Matrix: Drinking Water Sampled: 08/30/24 00:00:00									
Metals									
Lead	127		5	5.0	µg/L	08/31/24 16:48	08/31/24 16:48	JH	EPA 200.8 (Dig)/EPA 200.8
Sample: PUFSD-0894 Lims Reference ID: EC55907-02 Matrix: Drinking Water Sampled: 08/30/24 00:00:00									
Metals									
Lead	3.0		1	1.0	µg/L	08/31/24 12:49	08/31/24 12:49	JH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0907 Lims Reference ID: EC55907-03 Matrix: Drinking Water Sampled: 08/30/24 00:00:00									
Metals									
Lead	7.9		1	1.0	µg/L	08/31/24 12:50	08/31/24 12:50	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455907**LIMS Reference ID:** EC55907**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB#: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/30/2024 12:46

Reported:

08/31/2024 17:11

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455907
LIMS Reference ID: EC55907
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: JCB#: 23-53781, Plainedge Middle School,
Plainedge Union Free School District, 200
Stewart Avenue, Plainedge, NY 11714

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 08/30/2024 12:46
Reported: 08/31/2024 17:11


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building: Plainedge Middle School

PMS

Client:

Plainedge Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0907	NO	N/A	Student Health Services A118	SN	9/13/2024	6:50:00 AM

Samples Submitted 1

Courier

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
SEP 13 2024 PM12:24

Pb 200.8 8th 9/13/24

Building Address

200 Stewart Avenue

Plainedge, NY 11714

Analysis Type: ELAP 200.5

Lab Received: 9/13/24 12:24

Signature: [Signature] (KARLYN) WAGNER

Samplers Name: Anthony Lombardo

Samplers Signature: [Signature]

JCB Project Manager: LOMBARDO

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062456200**LIMS Reference ID:** EC56200**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

Plainedge Middle School: 200 Stewart Avenue,
Plainedge, NY 11714: Plainedge Union Free
School District: Project# 23-53781

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

09/13/2024 12:24

Reported:

09/17/2024 12:04

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062456200**LIMS Reference ID:** EC56200**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

Plainedge Middle School: 200 Stewart Avenue,
Plainedge, NY 11714: Plainedge Union Free
School District: Project# 23-53781

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

09/13/2024 12:24

Reported:

09/17/2024 12:04

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building: Plainedge High School

PHS

Client:

Plainedge Union Free School District

Retest/New Install []

Turn Around: Normal 1-wk Rush _____

Page 1 of 3

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0571	KI	1005	Kitchen	KC	6/12/2024	5:13:00 AM
PUFSD-0575	SA	1005E	Kitchen Serving Area	KC	6/12/2024	5:16:00 AM
PUFSD-0597	OF	1061	Room 116	KC	6/12/2024	5:48:00 AM
PUFSD-0652	ST	1052C	Ice Machine	IM	6/12/2024	5:27:00 AM
PUFSD-0654	HA	1052	Physical Ed/Health Corridor	DW	6/12/2024	5:26:00 AM
PUFSD-0656	LR	1049B	Boy's Locker Room	DW	6/12/2024	5:30:00 AM
PUFSD-0661	GY	1049	Gymnasium	WF	6/12/2024	5:25:00 AM
PUFSD-0662	GY	1049	Gymnasium	WC	6/12/2024	5:25:00 AM
PUFSD-0713	FL	1018	Faculty Room	KC	6/12/2024	5:41:00 AM
PUFSD-0717	NO	1016	Nurse's Office	BWC	6/12/2024	5:42:00 AM
PUFSD-0718	NO	1016C	Nurse's Office	NS	6/12/2024	5:42:00 AM
PUFSD-0721	HE	1011	Room 112	EC	6/12/2024	5:50:00 AM
PUFSD-0723	OF	1007	Main Office Suite	DW	6/12/2024	5:47:00 AM
PUFSD-0728	OF	1024	Administration Office	KC	6/12/2024	5:53:00 AM
PUFSD-0729	OF	1024	Administration Office	BW	6/12/2024	5:53:00 AM
PUFSD-0736	FL	1024R	Admin Faculty Lounge	KC	6/12/2024	5:56:00 AM
PUFSD-0737	FL	1024R	Admin Faculty Lounge	BW	6/12/2024	5:56:00 AM
PUFSD-0738	LI	1032	Library	KC	6/12/2024	6:02:00 AM

Building Address

241 Wyngate Drive.

Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received: A. Minnifield

Signature: A. Minnifield

6/14/24 1:02 PM

Sampler's Name: Conor Malanaphy

Sampler's Signature: Conor Malanaphy

JCB Project Manager: Anthony Lombardo

Courier



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building: Plainedge High School

PHS

Client:

Plainedge Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0739	LI	1032	Library	KC	6/12/2024	6:03:00 AM
PUFSD-0750	SP	1031F	Board Room Bathroom Vestibule	WC	6/12/2024	6:01:00 AM
PUFSD-0761	EXT	N/A	Concession Stand Kitchen	KC	6/12/2024	6:35:00 AM
PUFSD-0787	CA	1002	Cafeteria	WC	6/12/2024	5:09:00 AM
PUFSD-0788	CA	1002	Cafeteria	WC	6/12/2024	5:09:00 AM
PUFSD-0789	CA	1002	Cafeteria	WF	6/12/2024	5:09:00 AM
PUFSD-0790	HA	1066	Corridor Auditorium to Room 124	WC	6/12/2024	5:20:00 AM
PUFSD-0791	HA	1066	Corridor Auditorium to Room 124	WF	6/12/2024	5:20:00 AM
PUFSD-0798	KI	1005	Kitchen	KC	6/12/2024	5:13:00 AM
PUFSD-0799	KI	1005	Kitchen	KC	6/12/2024	5:12:00 AM
PUFSD-0800	KI	1005	Kitchen	KC	6/12/2024	5:12:00 AM
PUFSD-0801	KI	1004	Serving Area Kitchen	KC	6/12/2024	5:15:00 AM
PUFSD-0802	KI	1004	Serving Area Kitchen	KC	6/12/2024	5:15:00 AM
PUFSD-0817	GY	1051	New Weight Room (Old Fitness Center)	WF	6/12/2024	6:08:00 AM
PUFSD-0818	GY	1051	New Weight Room (Old Fitness Center)	WC	6/12/2024	6:08:00 AM
PUFSD-0819	GY	1051	New Weight Room 2nd Floor (Old Fitness Center)	WF	6/12/2024	6:10:00 AM
PUFSD-0820	GY	1051	New Weight Room 2nd Floor (Old Fitness Center)	WC	6/12/2024	6:10:00 AM
PUFSD-0878	OF	1024	Admin Office Kitchen Refrigerator	WC	6/12/2024	5:58:00 AM

Building Address

241 Wyngate Drive.

Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received:

Signature: A. Minnifield

6/14/24 1:02pm

Samplers Name: Cesar Matanaphy

Samplers Signature: C. Matanaphy

JCB Project Manager: Anthony Lombardo



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53781
Building: Plainedge High School
PHS

Client: Plainedge Union Free School District
Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0879	OF	1024	Admin Office Kitchen Refrigerator	IM	6/12/2024	5:58:00 AM
PUFSD-0880	KI	1005	Kitchen	KC	6/12/2024	5:14:00 AM
PUFSD-0881	KI	1005	Kitchen	PK	6/12/2024	5:14:00 AM
PUFSD-0882	EX	N/A	Concessions Stand Kitchen	IM	6/12/2024	6:36:00 AM
PUFSD-0883	OF	1013E	Guidance Office	BW	6/12/2024	5:45:00 AM
PUFSD-0898	NO	1016	Nurse's Office	BWH	6/12/2024	5:42:00 AM
PUFSD-0899	HE	1011	Room 112	SN	6/12/2024	5:50:00 AM
PUFSD-0900	OF	1024	Admin Office	BWH	6/12/2024	5:54:00 AM
PUFSD-0901	FL	1024R	Admin Faculty Lounge	BWH	6/12/2024	5:57:00 AM

Samples Submitted 45

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 14 PM 1:02

Building Address
241 Wyngate Drive.
Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received: A. Minnifield

Signature: A. Minnifield
6/14/24 1:02pm

Samplers Name: Connor Malungashy

Samplers Signature: Connor Malungashy

JCB Project Manager: Anthony Lombardo

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453980**LIMS Reference ID:** EC53980**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/03/2024 12:45

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0571 Lims Reference ID: EC53980-01 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 17:35	06/21/24 17:35	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0575 Lims Reference ID: EC53980-02 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	5.8		1	1.0	µg/L	06/21/24 17:42	06/21/24 17:42	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0597 Lims Reference ID: EC53980-03 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	4.3		1	1.0	µg/L	06/21/24 17:43	06/21/24 17:43	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0652 Lims Reference ID: EC53980-04 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 17:45	06/21/24 17:45	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0654 Lims Reference ID: EC53980-05 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	1.5		1	1.0	µg/L	06/21/24 17:46	06/21/24 17:46	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0656 Lims Reference ID: EC53980-06 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	5.7		1	1.0	µg/L	06/21/24 17:48	06/21/24 17:48	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0661 Lims Reference ID: EC53980-07 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 17:49	06/21/24 17:49	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0662 Lims Reference ID: EC53980-08 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 17:51	06/21/24 17:51	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0713 Lims Reference ID: EC53980-09 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 17:52	06/21/24 17:52	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453980**LIMS Reference ID:** EC53980**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/03/2024 12:45

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0717 Lims Reference ID: EC53980-10 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 17:53	06/21/24 17:53	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0718 Lims Reference ID: EC53980-11 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 17:58	06/21/24 17:58	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0721 Lims Reference ID: EC53980-12 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 18:02	06/21/24 18:02	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0723 Lims Reference ID: EC53980-13 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 18:04	06/21/24 18:04	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0728 Lims Reference ID: EC53980-14 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	1.3		1	1.0	µg/L	06/21/24 18:05	06/21/24 18:05	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0729 Lims Reference ID: EC53980-15 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 18:06	06/21/24 18:06	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0736 Lims Reference ID: EC53980-16 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	06/21/24 18:08	06/21/24 18:08	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0737 Lims Reference ID: EC53980-17 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 18:09	06/21/24 18:09	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0738 Lims Reference ID: EC53980-18 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	188		5	5.0	µg/L	06/21/24 18:11	07/01/24 11:34	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453980**LIMS Reference ID:** EC53980**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/03/2024 12:45

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0739 Lims Reference ID: EC53980-19 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	06/21/24 18:15	06/21/24 18:15	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0750 Lims Reference ID: EC53980-20 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	06/21/24 18:17	06/21/24 18:17	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0761 Lims Reference ID: EC53980-21 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	2.9		1	1.0	µg/L	06/21/24 15:57	06/21/24 15:57	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0787 Lims Reference ID: EC53980-22 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:01	06/21/24 16:01	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0788 Lims Reference ID: EC53980-23 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:03	06/21/24 16:03	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0789 Lims Reference ID: EC53980-24 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:04	06/21/24 16:04	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0790 Lims Reference ID: EC53980-25 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:06	06/21/24 16:06	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0791 Lims Reference ID: EC53980-26 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:07	06/21/24 16:07	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0798 Lims Reference ID: EC53980-27 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:09	06/21/24 16:09	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453980**LIMS Reference ID:** EC53980**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/03/2024 12:45

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0799 Lims Reference ID: EC53980-28 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:10	06/21/24 16:10	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0800 Lims Reference ID: EC53980-29 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	1.9		1	1.0	µg/L	06/21/24 16:14	06/21/24 16:14	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0801 Lims Reference ID: EC53980-30 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:16	06/21/24 16:16	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0802 Lims Reference ID: EC53980-31 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:17	06/21/24 16:17	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0817 Lims Reference ID: EC53980-32 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:22	06/21/24 16:22	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0818 Lims Reference ID: EC53980-33 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:23	06/21/24 16:23	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0819 Lims Reference ID: EC53980-34 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:25	06/21/24 16:25	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0820 Lims Reference ID: EC53980-35 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:26	06/21/24 16:26	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0878 Lims Reference ID: EC53980-36 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	7.4		1	1.0	µg/L	06/21/24 16:27	06/21/24 16:27	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453980**LIMS Reference ID:** EC53980**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/03/2024 12:45

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0879 Lims Reference ID: EC53980-37 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	5.8		1	1.0	µg/L	06/21/24 16:32	06/21/24 16:32	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0880 Lims Reference ID: EC53980-38 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/21/24 16:33	06/21/24 16:33	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0881 Lims Reference ID: EC53980-39 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:44	06/27/24 10:44	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0882 Lims Reference ID: EC53980-40 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:46	06/27/24 10:46	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0883 Lims Reference ID: EC53980-41 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:50	06/27/24 10:50	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0898 Lims Reference ID: EC53980-42 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:51	06/27/24 10:51	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0899 Lims Reference ID: EC53980-43 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	4.2		1	1.0	µg/L	06/27/24 10:53	06/27/24 10:53	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0900 Lims Reference ID: EC53980-44 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:54	06/27/24 10:54	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0901 Lims Reference ID: EC53980-45 Matrix: Drinking Water Sampled: 06/12/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:56	06/27/24 10:56	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453980**LIMS Reference ID:** EC53980**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 13:02

Reported:

07/03/2024 12:45

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453980
LIMS Reference ID: EC53980
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: #23-53781, Plainedge High School PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 13:02
Reported: 07/03/2024 12:45


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

EC55591

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

Plainedge High School

PHS

Client:

Plainedge Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0738	LI	1032	Library	KC	8/15/2024	7:08:00 AM
PUFSD-0757	EXT	N/A	Field House	WF	8/15/2024	9:25:00 AM
PUFSD-0758	EXT	N/A	Field House	DW	8/15/2024	9:25:00 AM
PUFSD-0878	OF	1024	Admin Office Kitchen Refrigerator	WC	8/15/2024	7:03:00 AM
PUFSD-0879	OF	1024	Admin Office Kitchen Refrigerator	IM	8/15/2024	7:03:00 AM

Samples Submitted 5

Courier

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 AUG 16 P 12:53

Pb 200 -8 *[Signature]* 8/20/24

Building Address

241 Wyngate Drive.

Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received: *A. Minnifield*

Signature: *A. Minnifield*

8/21/24 12:53pm

Samplers Name: *Conor Malanaphy*

Samplers Signature: *Conor Malanaphy*

JCB Project Manager: *Anthony Lombardo*

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455591**LIMS Reference ID:** EC55591**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School, PHS,
Plainedge Union Free School District, 241
Wyngate Drive., Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:53

Reported:

08/20/2024 12:28

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0738 Lims Reference ID: EC55591-01 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	6.2		1	1.0	µg/L	08/18/24 16:50	08/18/24 16:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0757 Lims Reference ID: EC55591-02 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	08/18/24 16:51	08/18/24 16:51	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0758 Lims Reference ID: EC55591-03 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	08/18/24 16:52	08/18/24 16:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0878 Lims Reference ID: EC55591-04 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	1.8		1	1.0	µg/L	08/20/24 10:51	08/20/24 10:51	SEH	EPA 200.8 (Dig)/EPA 200.8
Sample: PUFSD-0879 Lims Reference ID: EC55591-05 Matrix: Drinking Water Sampled: 08/15/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	08/20/24 10:55	08/20/24 10:55	SEH	EPA 200.8 (Dig)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455591**LIMS Reference ID:** EC55591**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School, PHS,
Plainedge Union Free School District, 241
Wyngate Drive., Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:53

Reported:

08/20/2024 12:28

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455591**LIMS Reference ID:** EC55591**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School, PHS,
Plainedge Union Free School District, 241
Wyngate Drive., Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/16/2024 12:53

Reported:

08/20/2024 12:28

Notes and Definitions


Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Courier



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53781
Building: Plainedge High School
PHS

EC55909

Page 1 of 1

Client: Plainedge Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0738	LI	1032	Library	KC	8/30/2024	6:57:00 AM

Samples Submitted 1

962008
2-11-8/31/24

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 30 2024 PM12:48

Building Address

241 Wyngate Drive.
Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Recieved: A. Minnifield

Signature: A. Minnifield

Samplers Name: Anthony Lombardo

Samplers Signature: [Signature]

JCB Project Manager: LOMBARDO



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062455909
LIMS Reference ID: EC55909
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: 23-53781, Plainedge High School, PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 08/30/2024 12:48
Reported: 08/31/2024 17:12

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0738 Lims Reference ID: EC55909-01 Matrix: Drinking Water Sampled: 08/30/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	08/31/24 16:29	08/31/24 16:29	JH	EPA 200.8 (Dig)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455909**LIMS Reference ID:** EC55909**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, Plainedge High School, PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/30/2024 12:48

Reported:

08/31/2024 17:12

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455909**LIMS Reference ID:** EC55909**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

23-53781, Plainedge High School, PHS,
Plainedge Union Free School District, 241
Wyngate Drive. Massapequa NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

08/30/2024 12:48

Reported:

08/31/2024 17:12

Notes and Definitions


Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

EL S7054



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53781

Building:

Plainedge High School

PHS

Client:

Plainedge Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush _____

Courier

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0575	KI	1005E	Kitchen Serving Area	KC	10/18/2024	6:53:00 AM
PUFSD-0919	GY	1049	Gym	WF	10/18/2024	6:50:00 AM
PUFSD-0920	GY	1049	Gym	WC	10/18/2024	6:51:00 AM

Samples Submitted 3

RECEIVED
ENSL ANALYTICAL, INC.
Carle Place, NY
OCT 18 2024 PM12:37

B02008 8A - 10/24/24

Building Address

241 Wyngate Drive.

Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Anthony Lombardo

Samplers Signature:

JCB Project Manager:

LOMBARDO

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062457054
LIMS Reference ID: EC57054
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: #23-53781, Plainedge High School, Plainedge
Union Free School District, 241 Wyngate
Drive, Massapequa, NY 11758

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 10/18/2024 12:37
Reported: 10/24/2024 12:46

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0575 Lims Reference ID: EC57054-01 Matrix: Drinking Water Sampled: 10/18/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/24/24 10:48	10/24/24 10:48	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0919 Lims Reference ID: EC57054-02 Matrix: Drinking Water Sampled: 10/18/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/24/24 10:49	10/24/24 10:49	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0920 Lims Reference ID: EC57054-03 Matrix: Drinking Water Sampled: 10/18/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/24/24 10:50	10/24/24 10:50	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062457054**LIMS Reference ID:** EC57054**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School, Plainedge
Union Free School District, 241 Wyngate
Drive, Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

10/18/2024 12:37

Reported:

10/24/2024 12:46

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062457054**LIMS Reference ID:** EC57054**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

#23-53781, Plainedge High School, Plainedge
Union Free School District, 241 Wyngate
Drive, Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

10/18/2024 12:37

Reported:

10/24/2024 12:46


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53781

Building: ~~23-53781~~

Brian Moore Athletic Center

EC 53961

Client: Plainedge v FSD

Page 1 of 1

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
858	HA	N/A	Main Lobby	WC	6/14/2024	7:48
859	HA	↓	Main Lobby	WC	Samples Submitted ↓	7:49
860	KI		Community Room Kitchen	KC		7:52
877	KI		Community Room Kitchen	IM		7:53

Pb 200.8 B/Ming 6/20/24

Courier

Pb 200.8
Echert

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 14 P 12: 59

Building Address

313 N. Idaho Avenue

North Massapequa, NY 11758

Analysis Type: ELAP 200.5

Lab Received: Carle

Signature: [Signature]

Samplers Name: Anthony Lombardo

Samplers Signature: [Signature]

JCB Project Manager: LOMBARDO

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453961**LIMS Reference ID:** EC53961**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Brian Moore Athletic Center,
Plainedge UFSD, 313 N. Idaho Avenue, North
Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 12:59

Reported:

07/03/2024 12:00

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: 858 Lims Reference ID: EC53961-01 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 12:07	06/26/24 12:07	JH	EPA 200.8 (DA)/EPA 200.8
Sample: 859 Lims Reference ID: EC53961-02 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 12:12	06/26/24 12:12	JH	EPA 200.8 (DA)/EPA 200.8
Sample: 860 Lims Reference ID: EC53961-03 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	1.5		1	1.0	µg/L	06/26/24 12:13	06/26/24 12:13	JH	EPA 200.8 (DA)/EPA 200.8
Sample: 877 Lims Reference ID: EC53961-04 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/26/24 12:15	06/26/24 12:15	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453961**LIMS Reference ID:** EC53961**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Brian Moore Athletic Center,
Plainedge UFSD, 313 N. Idaho Avenue, North
Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 12:59

Reported:

07/03/2024 12:00

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453961**LIMS Reference ID:** EC53961**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB #: 23-53781, Brian Moore Athletic Center,
Plainedge UFSD, 313 N. Idaho Avenue, North
Massapequa, NY 11758

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 12:59

Reported:

07/03/2024 12:00


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53781

Building: Transportation Building

062405374

Client: Plainfield UFSD

Page 1 of 1

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☒

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
PUFSD-0867	FL	N/A	Meeting/Lunch Room	KC	6/12/2024	6:20
PUFSD-0868	FL	N/A	Meeting/Lunch Room	SN	Samples Submitted ↓	6:20
PUFSD-0869	FL	N/A	Meeting/Lunch Room	WC		6:19
PUFSD-0875	OF	N/A	Transport Command Center	BWC		6:22
PUFSD-0902	OF	N/A	Transport Command Center	BWH		6:22

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 14 P 12:59
inter

Building Address

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Conor Malanaphy

Samplers Signature: Conor Malanaphy

JCB Project Manager: Anthony Lombardo

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453974**LIMS Reference ID:** EC53974**EMSL Customer ID:** JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: JCB# 23-53781, Transportation Building,
Plainedge UFSD

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 12:59
Reported: 07/03/2024 12:04

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: PUFSD-0867 Lims Reference ID: EC53974-01 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 09:58	06/27/24 09:58	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0868 Lims Reference ID: EC53974-02 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:00	06/27/24 10:00	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0869 Lims Reference ID: EC53974-03 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:37	06/27/24 10:37	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0875 Lims Reference ID: EC53974-04 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:41	06/27/24 10:41	BP	EPA 200.8 (DA)/EPA 200.8
Sample: PUFSD-0902 Lims Reference ID: EC53974-05 Matrix: Drinking Water Sampled: 06/14/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/27/24 10:43	06/27/24 10:43	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453974**LIMS Reference ID:** EC53974**EMSL Customer ID:** JCBR50**Attention:** Anthony Lombardo

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name:

JCB# 23-53781, Transportation Building,
Plainedge UFSD

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/14/2024 12:59

Reported:

07/03/2024 12:04

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062453974
LIMS Reference ID: EC53974
EMSL Customer ID: JCBR50

Attention: Anthony Lombardo
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
alombardo@jcbroderick.com

Project Name: JCB# 23-53781, Transportation Building,
Plainedge UFSD

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/14/2024 12:59
Reported: 07/03/2024 12:04

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.


Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.

Attachment 4:

Laboratory Certifications

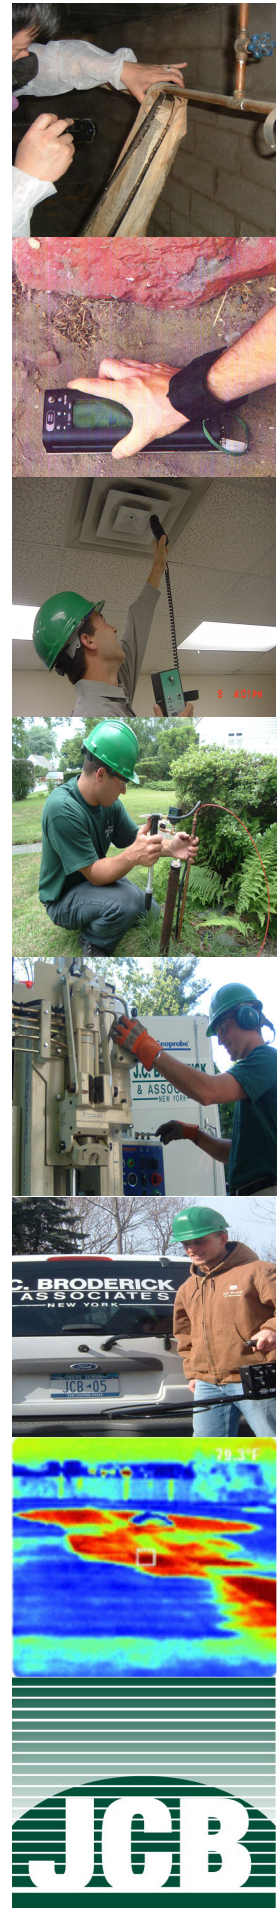

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2025
Issued April 01, 2024

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5 EPA 200.8 Rev. 5.4
-------------	---------------------------------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------



Serial No.: 68787

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at <https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/>, by phone (518) 485-5570 or by email to elap@health.ny.gov.

